


# 'Apollo' Valves

## MAINTENANCE MANUAL

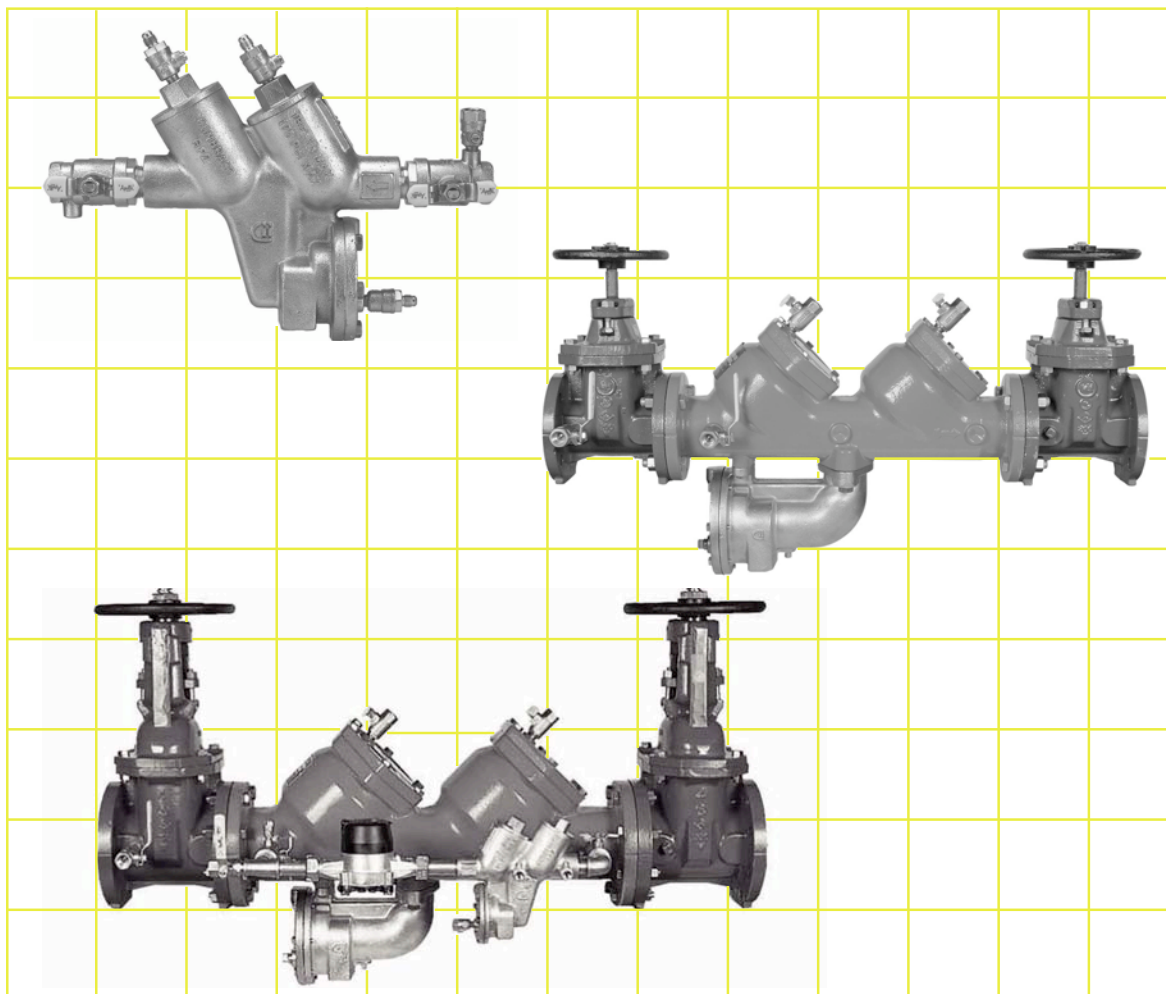

**Covering Models:**

**40-200 Series (1/4" - 10")**

**40-200S Series (1/4" - 1")**

**40-700 Series (3" - 10")**

### **REDUCED PRESSURE PRINCIPLE (RPZ) BACKFLOW PREVENTERS 1/4" - 10" AND REDUCED PRESSURE DETECTOR ASSEMBLY (RPDA) 3" - 10"**

For the lead free version of the 40-200 Series, refer to  
[www.apollovalves.com](http://www.apollovalves.com)

Conbraco Industries, Inc.  
P.O. Box 247  
Matthews, NC 28106  
Phone: (704) 841-6000  
Fax 704-841-6020  
[www.apollovalves.com](http://www.apollovalves.com)

---

---

# TABLE OF CONTENTS

## Reduced Pressure Principle Backflow Preventer 1/4" - 10" & Reduced Pressure Detector Assembly 3" - 10"

<b>Section</b>	<b>Page</b>
<b>I</b> Description and Operation .....	.2
<b>II</b> Installation .....	.3
<b>III</b> Trouble Shooting Guide .....	.4
<b>IV</b> Maintenance Instructions 1/4" - 2" .....	.5
<b>V</b> Maintenance Instructions 2-1/2" - 10" .....	.6
<b>VI</b> Testing Procedure 1/4" - 10" .....	.7 - 10
<b>VII</b> Part List 1/4" - 2" (Bronze Body) .....	.11, 12
<b>VIII</b> Parts List 1/4" - 1" (Stainless Steel Body) .....	.13, 14
<b>IX</b> Parts List 2-1/2" - 10" (Ductile Iron Body) .....	.15 - 20
<b>X</b> Parts List 3" - 10" RPDA .....	.21 - 24
<b>XI</b> Backflow Preventer Test Kits .....	.26

---

---

# Reduced Pressure Principle Backflow Preventer

## I DESCRIPTION AND OPERATION

The RPZ device consists of two independently acting, spring loaded, poppet type check valves, together with a hydraulically dependent, mechanically independent pressure differential relief valve, located in the zone between the check valves. Two resilient seated shut-off valves and four test cocks complete the assembly.

During normal operation, the pressure drop across the first check valve into the "zone" area is approximately 7 PSI. The second check valve is lightly spring loaded

to provide a minimum pressure drop of 1 PSI across it. (See Fig. 1)

The relief valve operates on a differential pressure. Supply pressure on the upstream side of the first check valve acts against the diaphragm to close the relief valve during normal operation. In the event of back-pressure, the relief valve will open to maintain the pressure in the "zone" at least 2 PSI less than the inlet pressure.

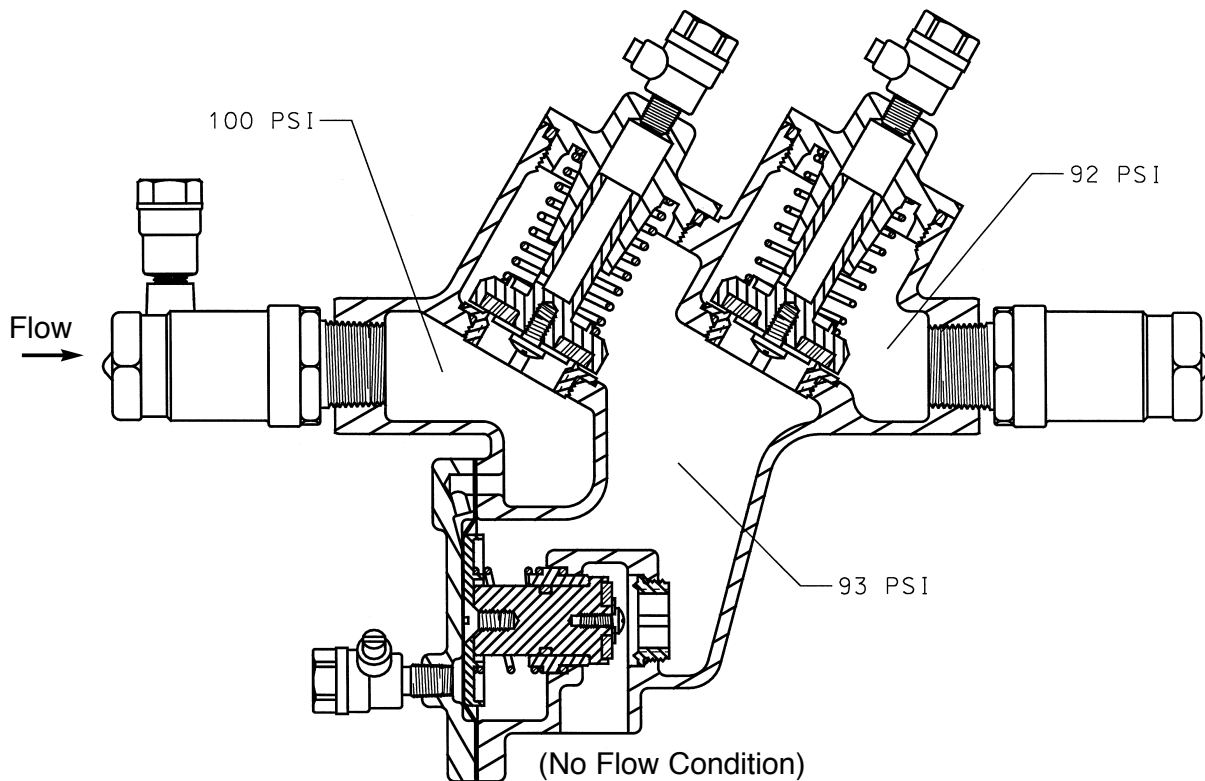


FIGURE 1

## REDUCED PRESSURE DETECTOR ASSEMBLY (RPDA)

The RPDA device consists of a mainline RPZ and a by-pass assembly consisting of an approved RPZ assembly and water meter. Each device is equipped with test cocks for periodic field testing and is normally supplied with inlet and outlet shut-off valves.


For information on operation, installation, trouble shooting & testing refer to Installation Instruction Booklet I503600 furnished with each RPDA unit. For maintenance instructions see pages 5 & 6. For parts list see pages 21 - 24.

## II INSTALLATION

- (a) The RPZ device must be installed in an accessible location to facilitate periodic field testing and maintenance.
- (b) The location selected should have adequate drainage for relief valve discharge. Drainage may be piped away, providing an approved air gap device is used (see Fig. 2). The device should never be placed where it may become submerged in standing water.
- (c) Flush all upstream piping thoroughly to remove foreign matter prior to installing the device.
- (d) Install the device in a horizontal position with adequate clearance from walls and/or obstructions, for testing and maintenance. A 12" to 30" clearance between the lower most portion of the device and flood grade or floor should be provided.
- (e) When shut-off valves are supplied separately, they should be installed with a test cock on the upstream side of the inlet shut-off valve.
- (f) A "Y" strainer can be installed just upstream of the RPZ assembly to eliminate any debris from entering the device and fouling the check and/or relief valve.
- (g) When installing the assembly, use pipe sealant on external threads only (if applicable).
- (h) Use wrench grips provided when installing (if applicable).
- (i) After installing the assembly, and with downstream or #2 shut-off valve closed, pressurize the RPZ device and bleed air through test cock #4. Then open #2 shut-off valve.

### NOTE:

**If water continues to drain from the relief valve, check the Trouble Shooting section for probable causes and solutions.**

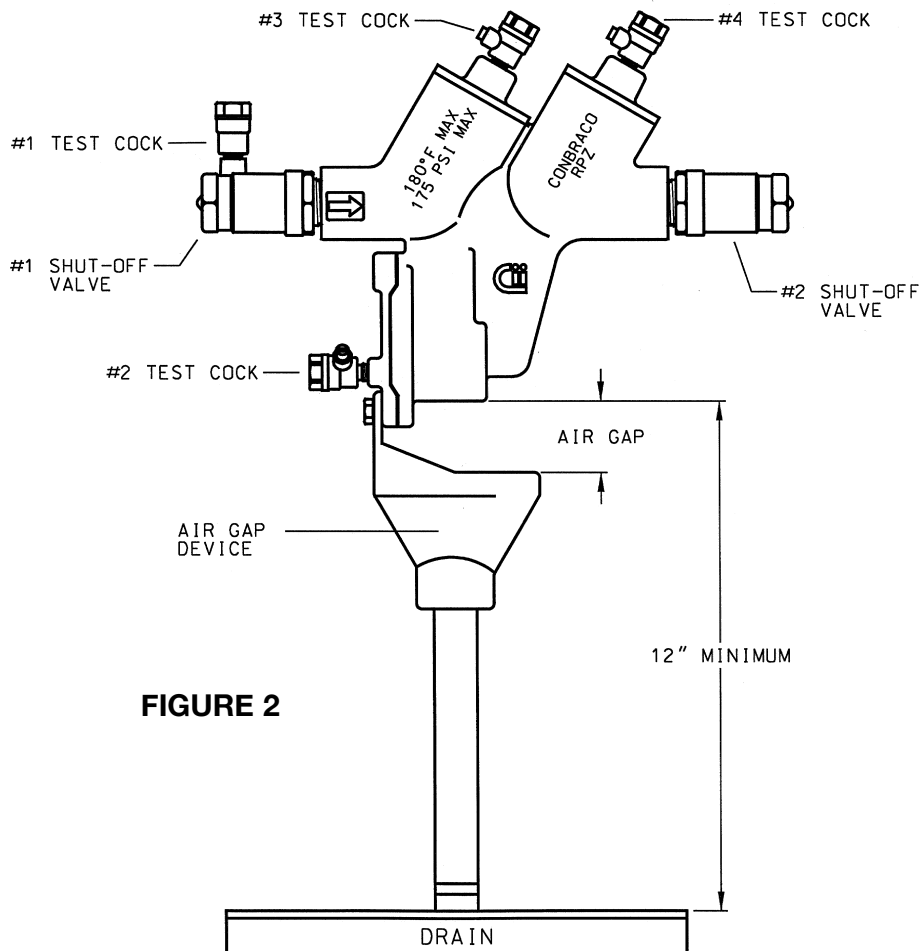

**FIGURE 2**

### III TROUBLE SHOOTING GUIDE

SYMPTOM	CAUSE	CORRECTIVE ACTION
<p>1. Relief valve continuously discharges during no-flow condition.</p>	<p>a. #1 check valve fouled with debris.  b. #2 check valve fouled with debris coupled with a backpressure condition.  c. #1 check poppet stem not moving freely in guide (or #2 check poppet during a backpressure condition.)</p>	<p>a. Inspect and clean seat disc and seat.  b. Inspect and clean seat disc and seat.  c. Inspect for debris or deposit on poppet stem or guide.</p>
<p>2. Relief valve discharges continuously during flow and no-flow conditions.</p>	<p>a. Relief valve fouled with debris.  b. Damaged diaphragm (allows water to pass through from inlet to zone).  c. Sensing passage to inlet side of diaphragm plugged.  d. #1 check poppet stem not moving freely in poppet guide.</p>	<p>a. Inspect and clean relief valve seat disc and seat.  b. Replace diaphragm.  c. Inspect and clean passage in cover and body.  d. Inspect for debris or deposits on poppet stem or guide.</p>
<p>3. Relief valve discharges intermittently in a “spitting” action during no-flow condition.</p>	<p>a. Pressure fluctuations (water hammer) from supply.</p>	<p>a. Eliminate or reduce pressure fluctuations.</p>
<p>4. Relief valve does not open during field test No. 1.</p>	<p>a. #2 shut-off valve not closed completely.  b. Test equipment improperly installed.</p>	<p>a. Close #2 shut-off valve or inspect for possible through leakage.  b. Recheck test procedure.</p>
<p>5. #2 check valve fails to hold backpressure.</p>	<p>a. #2 shut-off valve not closed completely.  b. #2 check valve fouled with debris.  c. #2 check poppet stem not moving freely in guide.</p>	<p>a. Close #2 shut-off valve or inspect for possible through leakage.  b. Inspect and clean seat disc and seat.  c. Inspect for debris or deposits on poppet stem or guide.</p>
<p>6. Pressure differential across #1 check valve is low during field test No. 3 (must be a minimum of 3 PSI more than the opening differential pressure of the relief valve as recorded in Test No. 1).</p>	<p>a. #1 check valve fouled with debris.  b. Upstream pressure fluctuations causing inaccurate gauge reading.  c. #1 check poppet stem not moving freely in guide.</p>	<p>a. Inspect and clean seat disc and seat.  b. Eliminate pressure fluctuations.  c. Inspect for debris or deposits on poppet stem or guide.</p>

---

---

## IV 1/4" - 2" MAINTENANCE INSTRUCTIONS

### A. Disassembly — Check Valves

1. Close #2 shut off valve, then close #1 shut-off valve.
2. Bleed pressure from the assembly by opening #2, #3, and #4 test cock.

#### CAUTION:

**Caps are spring loaded and should be removed carefully to avoid personal injury.**

3. Unscrew cap using hex head provided.
4. Remove spring and poppet assembly from the body.

### B. Disassembly — Check Valve Poppet

#### CAUTION:

**Do not use pliers or other tools which may damage or scratch the plastic stem.**

1. Holding the poppet assembly in one hand, remove screw and retaining washer.
2. Remove the seat disc.
3. All parts should be carefully inspected for any damage or excessive wear and thoroughly rinsed in clean water prior to reassembly. Replace worn parts as necessary.

### C. Assembly — Check Valve Poppet

1. Install new disc in poppet, secure disc with retaining washer and screw.

#### NOTE:

**Due to symmetry of the disc, the old disc may be turned over to obtain an effective seal.**

### D. Assembly — Check Valve

1. Install the poppet assembly into the body.
2. Install the spring (heavy spring, larger diameter wire, goes into #1 check valve) onto the poppet.
3. Apply a thin coat of synthetic based lubricant on cap O-Ring.
4. Guide cap over spring and poppet stem and tighten cap.

### E. Relief Valve Disassembly

1. Remove cover bolts, cover and diaphragm.
2. Grasp the diaphragm plate and pull the assembly straight out of the body.
3. Holding the relief valve assembly in one hand, remove the screw and retaining washer.
4. Remove the seat disc.
5. Turn the assembly over, keeping the spring compressed by holding down on the diaphragm plate, remove the screw.
6. Remove the diaphragm plate, spring and bushing from the R.V. stem.
7. Remove the O-Ring from the R.V. stem.
8. All parts should be carefully inspected for any damage or excessive wear and thoroughly rinsed in clean water prior to reassembly. Replace worn parts as necessary.

### F. Assembly — Relief Valve

1. Apply a thin coat of synthetic base lubricant on O-Rings before installing.
2. Install O-Ring onto R.V. stem.
3. Slide bushing over R.V. stem and position spring onto bushing.
4. Position diaphragm plate and compress spring, install screw into R.V. stem.
5. Turn the assembly over and install seat disc, retaining washer and screw.
6. Install O-Ring onto bushing.
7. Slide complete assembly into the body.
8. Position diaphragm over flange, install cover and tighten bolts evenly.
9. Open #1 shut-off valve & bleed air out of the unit through #2, #3 and #4 test cocks; then open #2 shut-off valve.
10. Test complete assembly to ensure proper operation.

---

---

## V 2-1/2" - 10" MAINTENANCE INSTRUCTIONS

### A. Disassembly — Check Valves

1. Close #2 shut off valve, then close #1 shut-off valve.
2. Bleed pressure from the assembly by opening #2, #3, and #4 test cock.
3. Remove cover bolts and cover.

#### NOTE:

**The spring load on the cover will be removed when the cover bolts are backed off approximately 3/8".**

4. Remove the complete check assembly straight out of the valve body being careful not to damage the seat ring.
5. The check valve seat is threaded into the body and may be removed at this time if necessary (the seat is bolted into the body on the 10"unit).
6. To remove the seat disc, remove the retaining plate nut (on the 8" & 10" units remove the retaining plate bolts) and retaining plate, remove disc.

#### WARNING:

**The check valve spring is held in compression by the stem nut on top. This nut should not be removed unless the spring requires replacement.**

### B. Assembly — Check Valves

1. Install seat disc in holder and secure with retaining plate and retaining nut or bolts as applicable.

#### NOTE:

**Due to the symmetry of the disc, the old disc may be turned over to obtain an effective seal.**

2. Install the check valve assembly into the body (assemble with the larger diameter spring into the first check valve).
3. Apply a thin coat of synthetic based lubricant on the cover O-Ring and place it into the groove around the lip of the check barrel. Being careful not to disturb O-Ring, install the cover and tighten the bolts evenly.

### C. Disassembly — Relief Valve

1. Remove cover bolts, cover and diaphragm.

#### NOTE:

**On the 8" & 10" units the diaphragm is an integral part of the relief valve assembly.**

2. Grasp the diaphragm plate and pull the assembly straight out of the body.
3. Holding the relief valve assembly in one hand, remove the screw and retaining washer.
4. Remove the seat disc.
5. Turn the assembly over, keeping the spring compressed by holding down on the diaphragm plate, remove the screw/bolt.
6. Remove the diaphragm plate(s), spring and bushing from the R.V. stem.
7. Remove the O-Ring from the R.V. stem.
8. All parts should be carefully inspected for any damage or excessive wear and thoroughly rinsed in clean water prior to reassembly. Replace worn parts as necessary.

### D. Assembly — Relief Valve

1. Apply a thin coat of synthetic base lubricant on O-Rings before installing.
2. Install O-Ring onto R.V. stem.
3. Slide bushing over R.V. stem and position spring onto bushing.
4. Position diaphragm plate(s) and compress spring, install screw into R.V. stem.
5. Turn the assembly over and install seat disc, retaining washer and screw.
6. Install O-Ring onto bushing.
7. Slide complete assembly into the body testing for freedom of movement.
8. Position diaphragm over flange ensuring that the hole in the diaphragm for the sensing passage is in the correct position, install cover and tighten bolts evenly.
9. Open #1 shut-off valve & bleed air out of the unit through #2, #3 and #4 test cocks; then open #2 shut-off valve.
10. Test complete assembly to ensure proper operation.

---

---

## VI TESTING PROCEDURES

**IT'S IMPORTANT THAT THE RPZ BE TESTED PERIODICALLY IN COMPLIANCE WITH LOCAL CODES, BUT AT LEAST ONCE A YEAR OR MORE, AS SERVICE CONDITIONS WARRANT.**

### EQUIPMENT REQUIRED

Conbraco reduced pressure backflow preventer test kit 40-200-TKU, or 40-200-TK5U.

### TEST NO. 1:

**NOTE: Test set-up is illustrated in Figure 3.**

**PROCEDURE 1 for use with 40-200-TKU Test Kit only. See procedure 2 for 40-200-TK5U.**

#### Purpose:

To test operation of the pressure differential relief valve.

#### Requirement:

The pressure differential relief valve must operate to maintain the "zone" between the two check valves at a minimum of 2 PSI less than the supply pressure.

#### PROCEDURE:

1. Bleed water through all four test cocks to flush any foreign material.

**NOTE:** Open test cock #2 very slowly to avoid accidental dumping of the relief valve.

2. Connect the "high" side hose to test cock #2. Connect the "low" side hose to test cock #3.
3. Open valves #1, #2, and #3.
4. Slowly open test cock #3 and bleed all air from gauge and hoses through the "vent" hose. With test cock #3 maintained in the open position, slowly open test cock #2 and bleed all air again through the "vent" hose. Close valve #3. Then close valve #2.
5. Close #2 shut-off valve.
6. Slowly open valve #3 until the differential gauge needle starts to drop.

**NOTE:** It is important that the differential gauge needle drops slowly. Maintain #3 at this position and observe the differential pressure reading at the moment the first discharge is noted from the relief valve.

7. Record this reading as the opening differential pressure of the relief valve and close valve #3.

### TEST NO. 2:

#### Purpose:

To test check valve #2 for tightness against reverse flow.

#### Requirement:

The check valve shall permit no through leakage in a direction reverse to normal flow under all conditions of a pressure differential.

#### PROCEDURE:

1. Maintain the #2 shut-off valve in the closed position (from Test No. 1).
2. Loosely attach the "vent" hose to test cock #4.
3. Bleed all air from the "vent" hose by opening valve #2.
4. Close valve #2 and tighten hose connection to test cock #4. Then open test cock #4.
5. Loosen the "low" side hose at test cock #3 slightly and re-establish the normal reduced pressure within the zone. Then retighten hose.
6. Open valve #2. If the differential pressure remains steady then check valve #2 is reported as "OK". If the differential pressure falls until the relief valve opens then check valve #2 is recorded as "leaking" and Test No. 3 cannot be completed.

### TEST NO. 3:

#### Purpose:

To test the static differential pressure across check valve #1.

#### Requirement:

The static differential pressure across check valve #1 must be a minimum of 3 PSI more than the opening differential pressure of the relief valve as recorded in Test No. 1.

#### PROCEDURE:

1. With the testing equipment installed as stated in Test No. 2, the static differential pressure across check valve #1 will be indicated on the gauge and should be recorded as such.

**NOTE:** Gauge needle should be steady and not falling.


#### RESTORE OPERATION:

Close all test cocks, open all needle-valves, open #2 shut-off valve and carefully remove all test equipment.

**NOTE:** Refer to Troubleshooting Guide in section III to resolve any problems incurred during field testing.



# CONBRACO REDUCED PRESSURE BACKFLOW PREVENTER

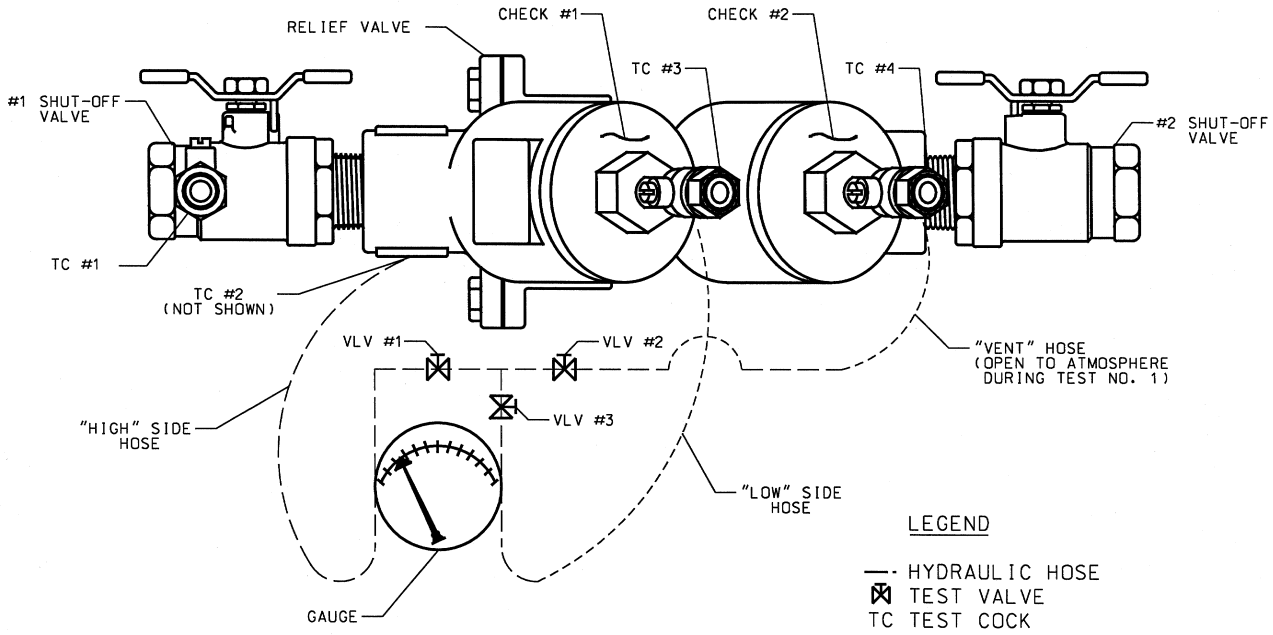


**FIGURE 3**  
(TOP VIEW SHOWN)

## PROCEDURE 2

### TEST PROCEDURE USING 40-200-TK5 or 40-200-TKRC TEST KIT

NOTE: IT IS THE TESTER'S RESPONSIBILITY TO DETERMINE IF THIS PROCEDURE IS ACCEPTED BY LOCAL AUTHORITIES.

# CONBRACO REDUCED PRESSURE BACKFLOW PREVENTER

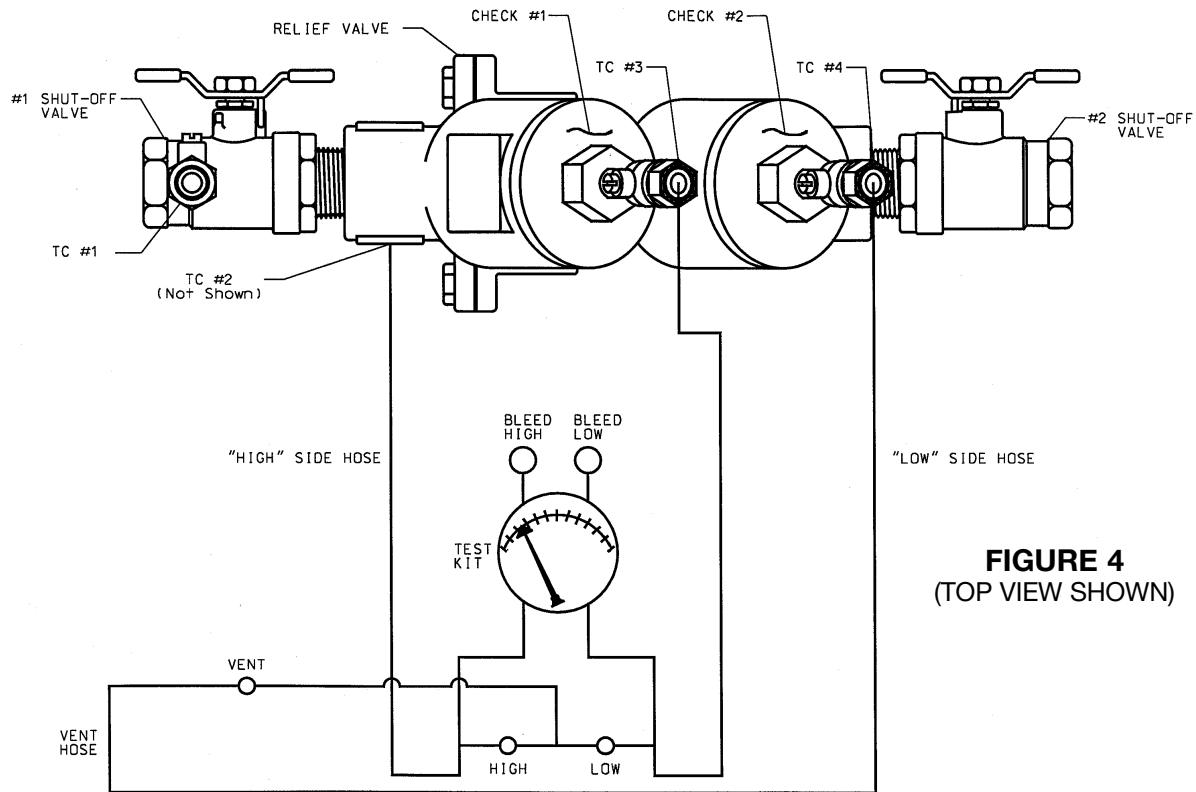

**FIGURE 4**  
(TOP VIEW SHOWN)

### TEST SET UP

1. Obtain permission to shut off the water supply.
2. Determine the direction of flow.
3. Identify and install appropriate adapters in all 4 test cocks.
4. All test kit valves are closed.

**TEST NO. 1** - DOES THE DIFFERENTIAL PRESSURE RELIEF VALVE OPERATE TO MAINTAIN THE "ZONE" BETWEEN THE TWO CHECK VALVES AT LEAST 2 PSI LESS THAN THE SUPPLY PRESSURE.

1. Open test cock 4 to establish flow through the RP. "Blow out" test cocks 1, 2 & 3.

**Note:** Open test cock 2 slowly to avoid accidental dumping of the relief valve. Close test cock 4.

2. Connect the red hose between test cock 2 and the high side (back, middle) connection on the test kit.

3. Connect the green hose between test cock 3 and the low side (back, right) connection on the test kit.
4. Slowly open test cock 3. Bleed the low side by opening the bleed low (top, right) valve.
5. Slowly open test cock 2. Bleed the high side by opening the bleed high (top, left) valve. Close the bleed high (top, left) valve.
6. After the gauge reaches full scale, close the bleed low (top, right) valve.
7. Close the No. 2 shutoff valve and observe the pressure drop across Check Valve 1. Should the pressure drop until the relief valve discharges continuously, check valve 1 is leaking and must be repaired before continuing.
8. Open the high (bottom, middle, red) valve.
9. Open the low (bottom, right, green) valve no more than one quarter (1/4) turn.

- 
10. Watch the gauge drop slowly to the relief valve opening point - record the reading. (If the differential pressure does not drop to the relief valve opening point, close the high and low valves and go to step 12).
  11. Close the high and low valves and go to test No. 2.
  12. No. 2 shutoff valve may be leaking. Reopen and close No. 2 shutoff valve to attempt a better shutoff. Repeat steps 7 through 10. If the relief valve does not open, a by-pass hose is required. (Large leaks may require a garden hose).
  13. Attach a hose (not supplied with Test Kit) to test cock 1. Bleed hose by opening test cock 1. Close test cock 1.
  14. Connect the hose from test cock 1 to test cock 4.
  15. Open test cock 1 to pressurize the hose.
  16. Slowly open test cock 4. Repeat steps 8 through 10. If the relief valve does not open, the leaky No. 2 shutoff valve must be repaired.

**TEST NO. 2 - IS CHECK VALVE 2 PRESSURE TIGHT AGAINST BACK PRESSURE.**

**NO BYPASS HOSE USED IN TEST 1.**

1. Connect the black hose to vent (back, left) connection on the test kit.
2. Bleed vent hose by opening the high (bottom, middle, red) and vent (bottom, left, black) valves. Close the vent valve.
3. Attach the vent hose to test cock 4.
4. Open test cock 4.
5. Open the bleed low (top, right) valve allowing the gauge to reach full scale. Close the bleed low valve.
6. Open the vent (bottom, left, black) valve.
7. If the differential pressure stabilizes above the relief valve opening point check valve 2 is recorded as "tight". (Proceed to test No. 3). If the reading falls to the relief valve opening point, check valve 2 is recorded as "leaking" and Test No. 3 cannot be completed.


**BYPASS HOSE USED IN TEST 1.**

1. Leave the bypass hose connected between test cocks 1 and 4.
2. Leave test cocks 1 and 4 open.
3. Open the bleed low (top, right) valve allowing the gauge to reach full scale. Close the bleed low valve.
4. If the differential pressure stabilizes above the relief valve opening point, check valve 2 is recorded as "tight". (Proceed to Test No. 3). If the reading falls to the relief valve opening point, check valve 2 is recorded as "leaking" and Test No. 3 cannot be completed.

**TEST NO. 3 - IS THE STATIC PRESSURE DROP ACROSS CHECK VALVE 1 MAINTAINED AT LEAST 3 PSI ABOVE THE RELIEF VALVE OPENING POINT.**

1. Open the bleed low (top, right) valve allowing the gauge to reach full scale. Close the bleed low valve.
2. Allow the gauge reading to stabilize. Record this reading as the static pressure drops across check valve 1.
3. Close all test cocks. Open the No. 2 shutoff valve. Remove all test equipment. Drain test kit.

**VII PARTS LISTING 1/4" - 2" (Bronze)**

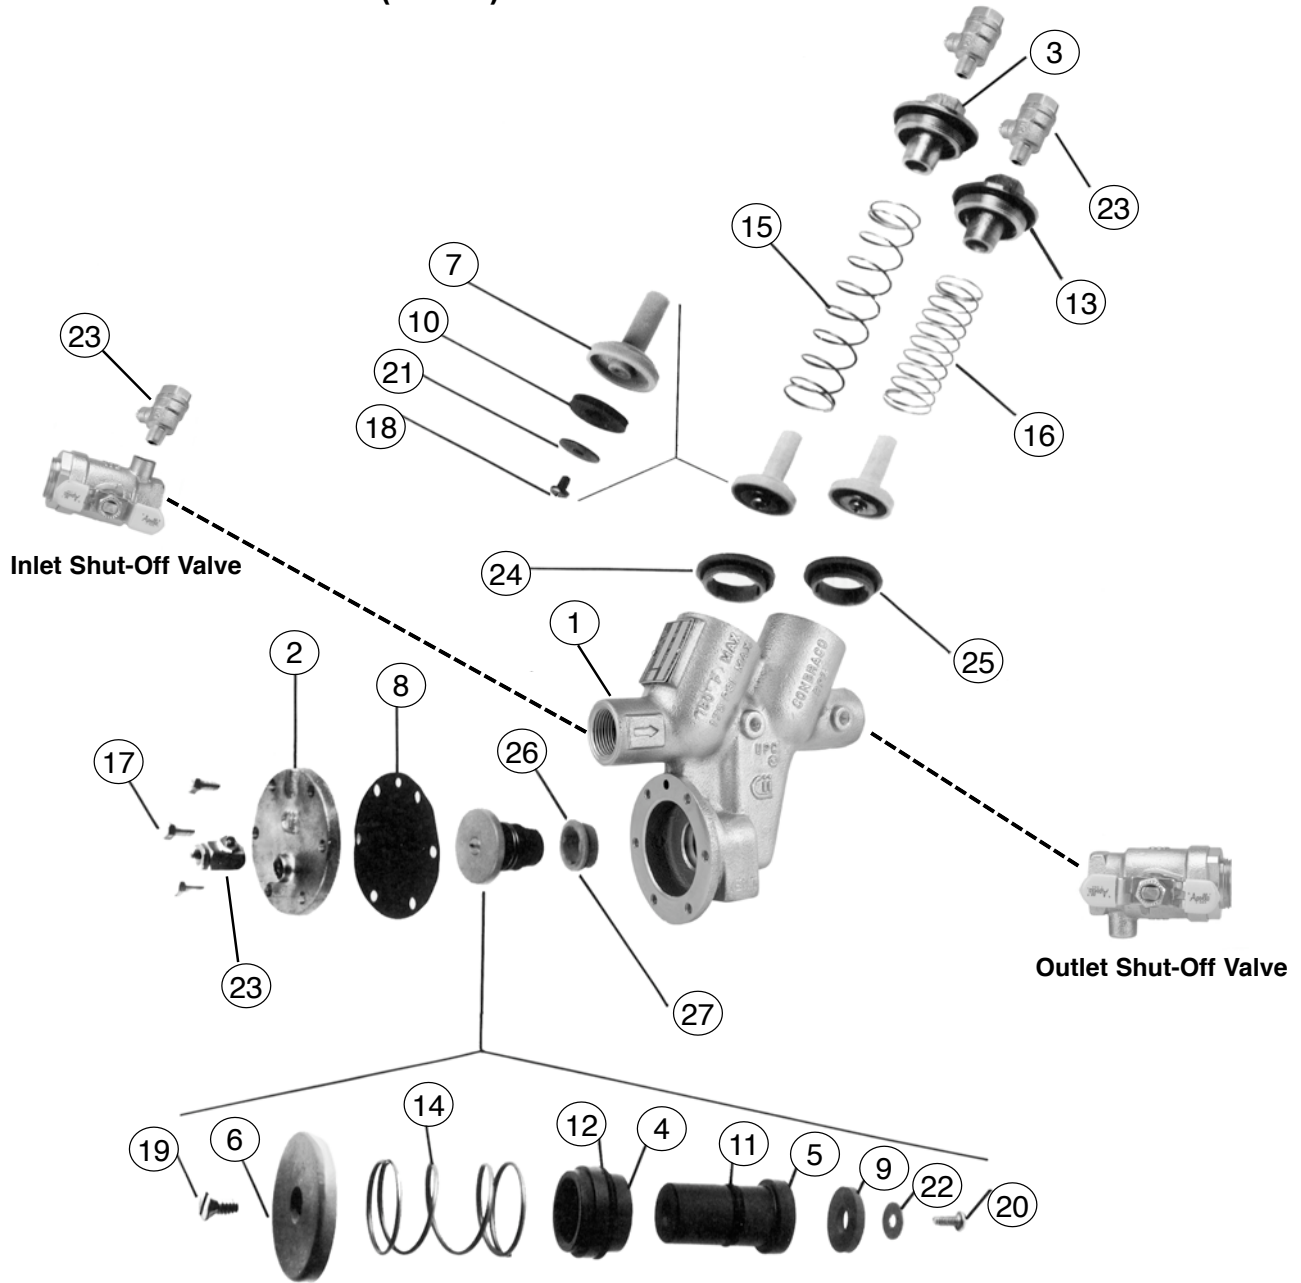

**Inlet and Outlet Shut-Off Valves  
40-20X-TX**

Size	1/4"	3/8"	1/2"	3/4"	1"	1-1/4"	1-1/2"	2"
Inlet Shut-Off Valve <i>(pictured)</i>	7B80101	7B80201	7B80301	7B80401	7B80501	7B80699A	7B80799A	7B80899A
Inlet Shut-Off Valve w/Union			7B30301	7B30401	7B30501	7B30699A	7B30799A	7B30899A
Outlet Shut-Off Valve <i>(pictured)</i>	7B80131	7B80231	7B80331	7B80431	7B80531	7B80699B	7B80799B	7B80899B
Outlet Shut-Off Valve w/Union			7B30331	7B30431	7B30531	7B30699B	7B30799B	7B30899B
Replacement Handles for Shut-Off Valves	W858800	W858800	W858800	W858800	W859100	W891500	W891600	W891600

**NOTE: For the lead free version of the 40-200 Series, refer to  
[www.apollovalves.com](http://www.apollovalves.com)**

## 40-200

### Reduced Pressure Principle Backflow Preventer

ITEM NO.	DESCRIPTION	QUANTITY	PART NO.		
			1/4", 3/8", 1/2"	3/4" & 1"	1 1/4", 1 1/2", 2"
1	Body	1	Consult Factory	Consult Factory	Consult Factory
2	R.V. Cover	1	F301705	F298205	F298505
3	Cap	2	F323105	F310805	F311505
4	R.V. Bushing	1	I450715	I424015	I425715
5	R.V. Stem	1	G329600	G321200	G321300
6	Diaphragm Plate	1	E222200	D250600	D251600
7	Poppet	2	K340900	K336200	K336700
8	R.V. Diaphragm	1	D263200	D250500	D251500
9	R.V. Seat Disc	1	D263100	D282900	D251400
10	Check Seat Disc	2	D263000	D250300	D250800
11	Stem O-Ring	1	D262800	D250200	D251300
12	Bushing O-Ring	1	D262900	D250100	D251200
13	Check Cap O-Ring	2	D204600	D250000	D251000
14	R.V. Spring	1	A179500	A169800	A170200
15	1st Check Spring	1	A179700	A169900	A170300
16	2nd Check Spring	1	A179400	A170000	A170100
17	Hex Head Bolt	6(*4) (**7)	B179300	B175100	B175400
18	Screw	2	B183700	B175000	B175000
19	Screw	1	B174900	B174900	B175300
20	Screw	1	B183700	B174800	B175300
21	Retaining Washer	2	E222300	D249900	D250900
22	Retaining Washer	1	E222400	D249800	D249900
23	Test Cock	4	7829001	7829001	7829101
24	Check Seat	2	L515200	L486400	L486600
25	Check O-Ring	2	D308600	D227400	D256500
26	R.V. Seat	1	L515300	L486300	L486700
27	R.V. O-Ring	1	D308700	D216800	D227400
	O-Ring Lubricant	1	I901600	I901600	I901600

#### Repair Kits\*\*\*

##### Major Repair Kit

4, 5, 6, 7 (2), 8, 9, 10 (2), 11, 12,  
13 (2), 14, 18 (2), 19, 20, 21 (2), 22,  
24 (2), 25 (2), 26, 27

40003A1

40004A1

40007A1

##### Check Valve Repair Kit

7, 10, 13, 18, 21, 24, 25

40003A2

40004A2

40007A2

##### Relief Valve Repair Kit

4, 5, 6, 8, 9, 11, 12, 14, 19, 20, 22,  
26, 27

40003A3

40004A3

40007A3

##### Rubber Repair Kit

8, 9, 10 (2), 11, 12, 13 (2), 25 (2), 27

40003A4

40004A4

40007A4

##### Replaceable Seat Kit

24 (2), 25 (2), 26, 27

40003A7

40004A7

40007A7

#### Accessories

Air Gap Drain

AGD4012

AGD401

40200X1

Seat Removal Tool

40000SRT

40000SRT

40000SRT


Reduced Pressure Backflow Preventer Test Kit 40200TKU, 40200TK5U, or 40200TKRC (All Sizes)

\* 1/4", 3/8" & 1/2" SIZES ONLY

\*\* 1-1/4", 1-1/2" & 2" SIZES ONLY

\*\*\* For repair kits without replaceable seat components, replace part number suffix designation "A" with "O".  
Example: Major Repair Kit part number 4000401

VIII PARTS LISTING 1/4" - 1" (Stainless Steel)

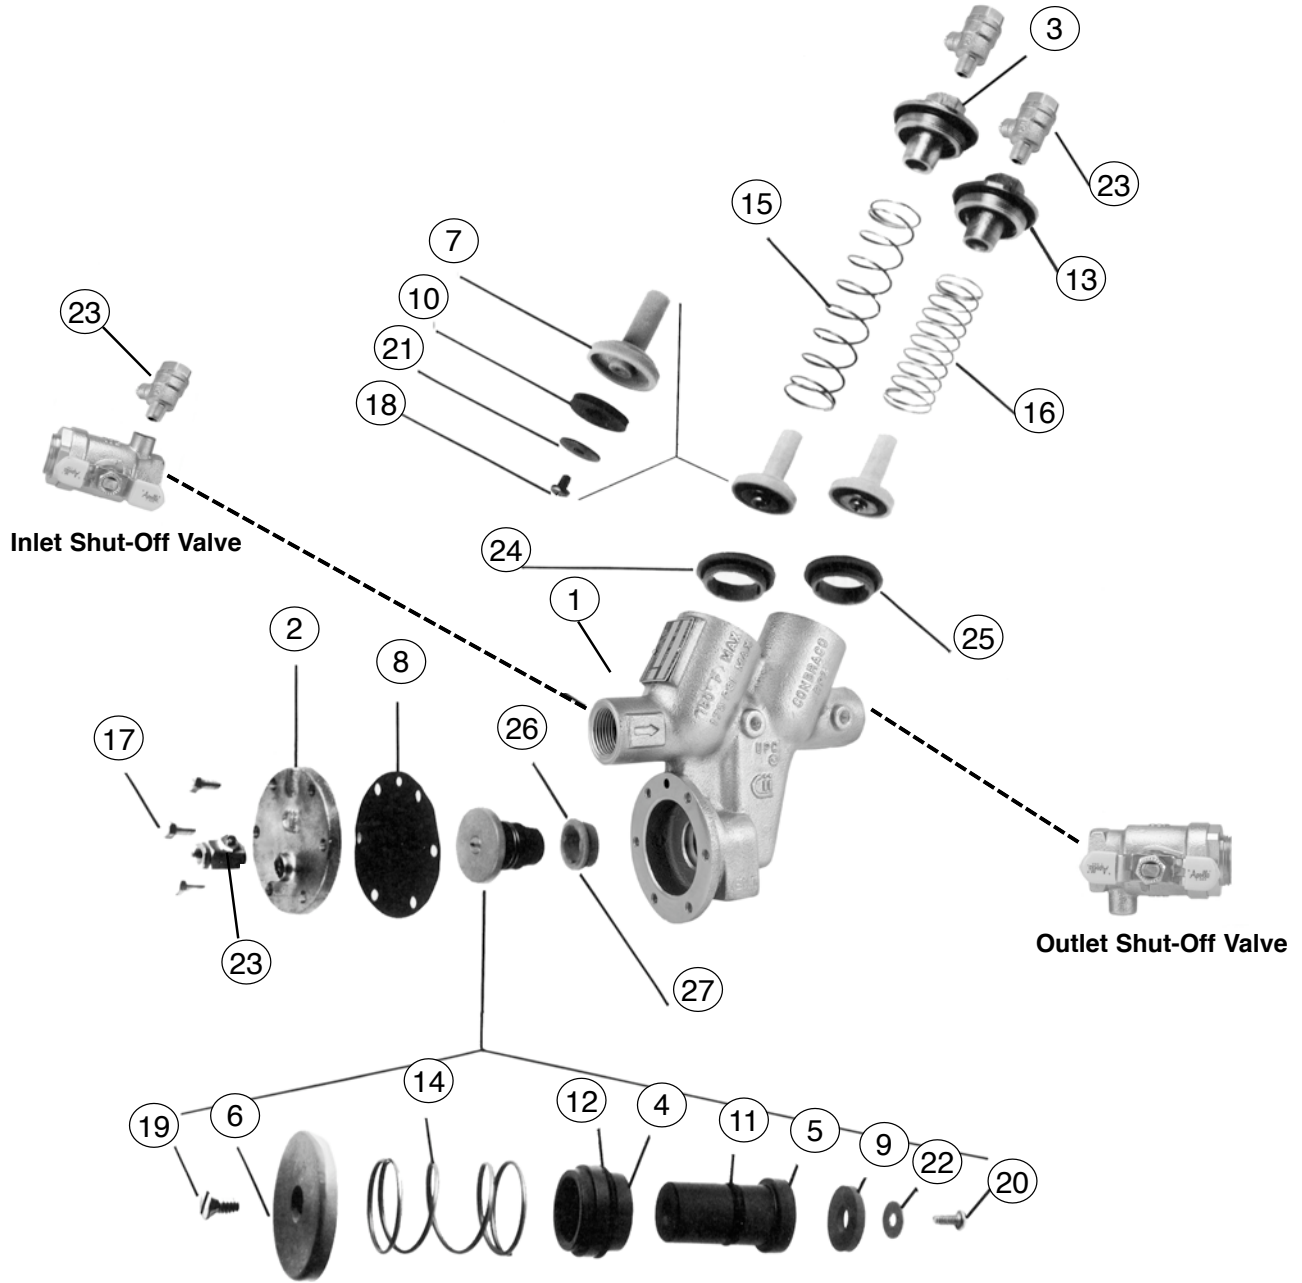

**Inlet and Outlet Shut-Off Valves  
40-20X-T2S**

Size	1/4"	3/8"	1/2"	3/4"	1"
Inlet Shut-Off Valve	7H80101	7H80201	7H80301	7H80401	7H80501
Outlet Shut-Off Valve	7H80131	7H80231	7H80331	7H80431	7H80531
Replacement Handles for Shut-Off Valves	W858800	W858800	W858800	W858800	H269300

**NOTE:** This stainless steel version of the 40-200 Series is constructed of all lead free components and complies with the requirements of CA AB-1953 and VT S.152.

**40-200S**  
**Stainless Steel Reduced Pressure Principle**  
**Backflow Preventer**

ITEM NO.	DESCRIPTION	QUANTITY	PART NO.	
			1/4", 3/8", 1/2"	3/4" & 1"
1	Body	1	Consult Factory	Consult Factory
2	R.V. Cover	1	F305605	F304805
3	Cap	2	F323205	F323305
4	R.V. Bushing	1	I514915	I510515
5	R.V. Stem	1	G329600	G321200
6	Diaphragm Plate	1	E222200	D250600
7	Poppet	2	K340900	K336200
8	R.V. Diaphragm	1	D308800	D304700
9	R.V. Seat Disc	1	D263100	D282900
10	Check Seat Disc	2	D263000	D250300
11	Stem O-Ring	1	D308400	D305100
12	Bushing O-Ring	1	D308500	D304400
13	Check Cap O-Ring	2	D308300	D305200
14	R.V. Spring	1	A179500	A169800
15	1st Check Spring	1	A179700	A169900
16	2nd Check Spring	1	A179400	A170000
17	Hex Head Bolt	4(*6)	B179300	B175100
18	Screw	2	B183700	B174800
19	Screw	1	B174900	B174900
20	Screw	1	B183700	B175000
21	Retaining Washer	2	E222300	D249900
22	Retaining Washer	1	E222400	D249800
23	Test Cock	4	7893001	7893001
24	Check Seat	2	L515200	L486400
25	Check O-Ring	2	D308600	D304600
26	R.V. Seat	1	L515300	L486300
27	R.V. O-Ring	1	D308700	D304500
	O-Ring Lubricant	1	I901600	I901600

**Repair Kits**

Major Repair Kit

4, 5, 6, 7 (2), 8, 9, 10 (2), 11, 12,  
13 (2), 14, 18 (2), 19, 20, 21 (2), 22,  
24 (2), 25 (2), 26, 27

40003A1S      40004A1S

Check Valve Repair Kit

7, 10, 13, 18, 21, 24, 25

40003A2S      40004A2S

Relief Valve Repair Kit

4, 5, 6, 8, 9, 11, 12, 14, 19, 20, 22,  
26, 27

40003A3S      40004A3S

Rubber Repair Kit

8, 9, 10 (2), 11, 12, 13 (2), 25 (2), 27

40003A4S      40004A4S

Replaceable Seat Kit

24 (2), 25 (2), 26, 27

40003A7S      40004A7S

**Accessories**

Air Gap Drain

40200XA      40200X1

Seat Removal Tool

40000SRT      40000SRT

Reduced Pressure Backflow Preventer Test Kit


40200TKU, 40200TK5U, or 40200TKRC  
(All Sizes)

\* 3/4", 1" SIZES ONLY

IX PARTS LISTING 2-1/2" - 10" (Ductile Iron)

2-1/2" - 3" - 4" - 6" RPZ (Model 40-200 Series)

(shown without relief valve)

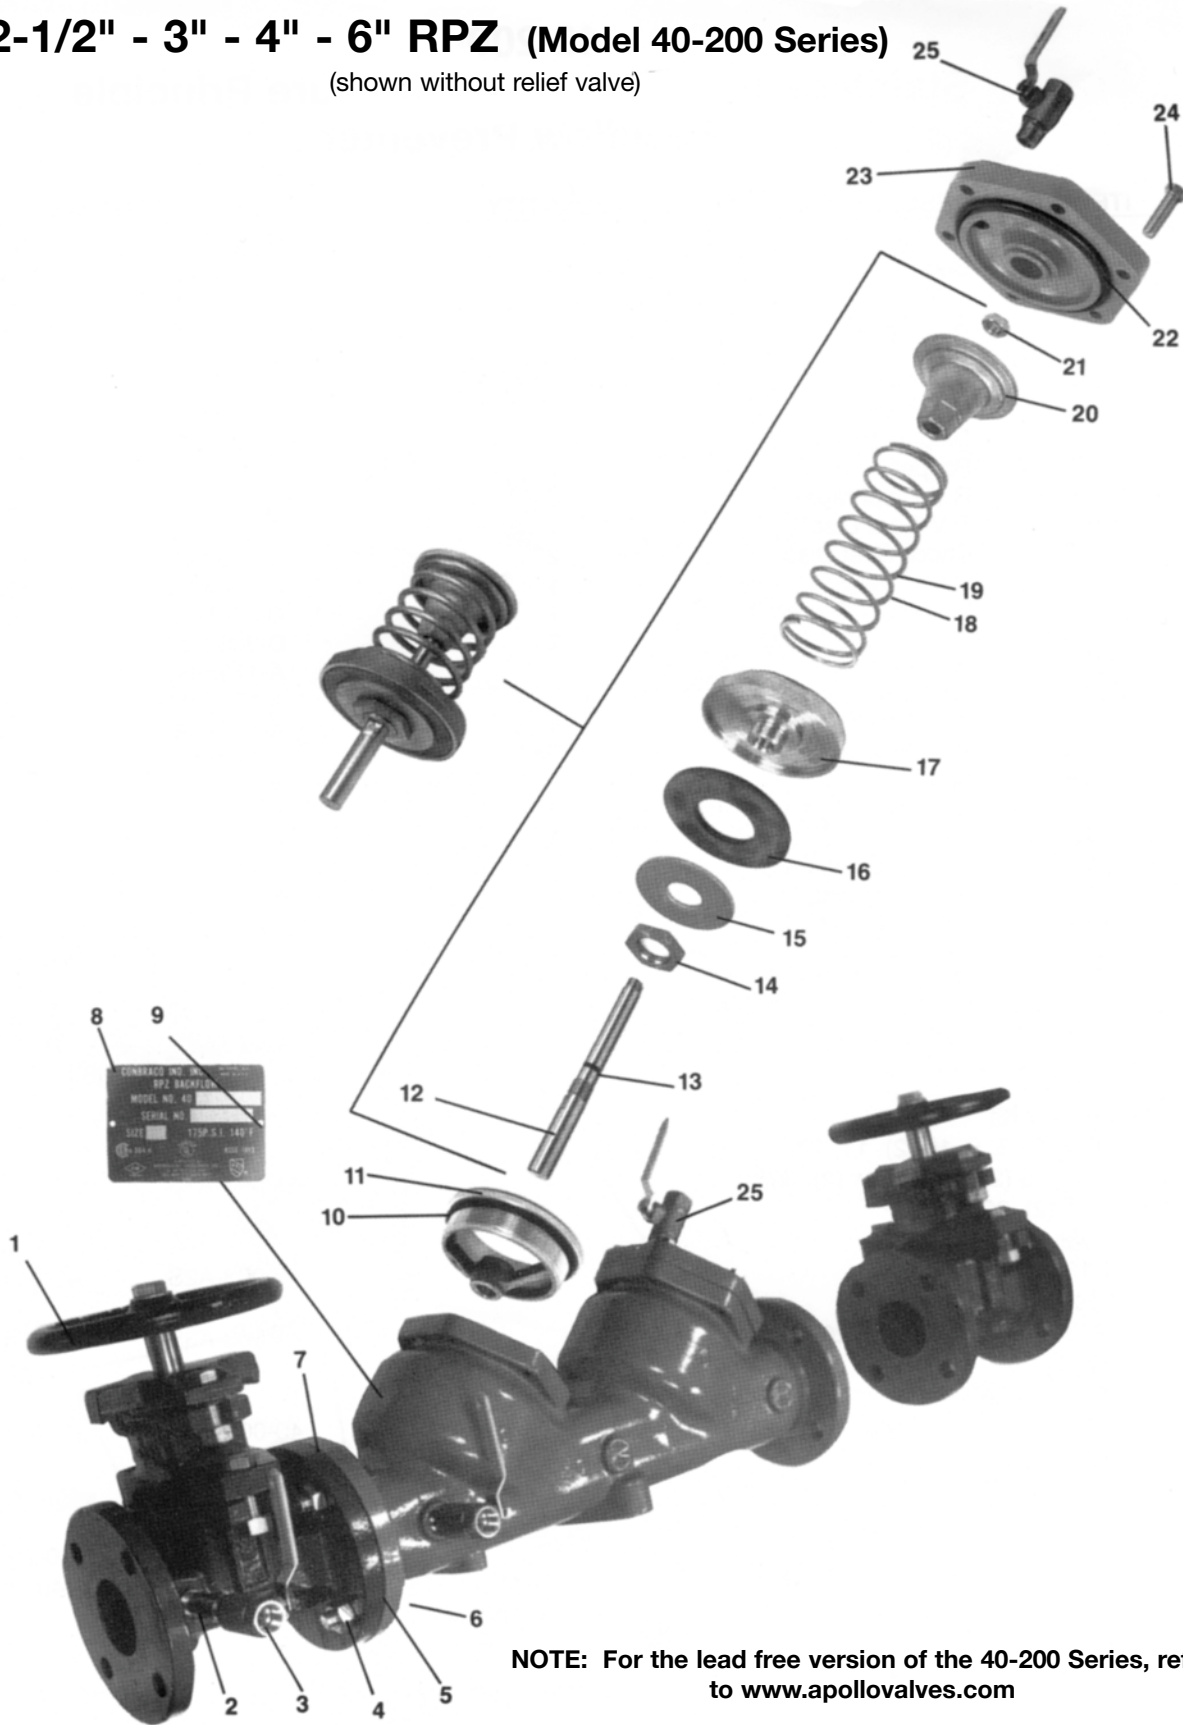

NOTE: For the lead free version of the 40-200 Series, refer to [www.apollovalves.com](http://www.apollovalves.com)




## RPZ (Model 40-200 Series) Parts List

ITEM NO.	DESCRIPTION	QUANTITY	PART NO.			
			2-1/2"	3"	4"	6"
1	Shut-Off Valve (OS&Y)	2	W678900	W679000	W682400	W682500
1	Shut-Off Valve (NRS)	2	W678500	W678600	W674300	W674400
2	Brass Nipple	1	K340600	K340600	K340600	K341240
3	Test Cock	1	7010301	7010301	7010301	7010401
4	Flange Nut	*	C169100	C169100	C169100	C175900
5	Ring Gasket	2	D258300	D258400	D258200	D257900
6	Flange Bolt	*	B180400	B180400	B182800	B182900
7	Body	1	Q452819	Q452919	Q453219	Q453819
8	Nameplate	1	I440600	I440600	I440600	I440600
9	Drive Screw	2	I261300	I261300	I261300	I261300
10	C.V. Seat O-Ring	2	D256700	D256700	D257300	D257600
11	C.V. Seat	2	L463705	L463705	L464005	L464405
12	C.V. Stem	2	G323906	G323906	G324206	G324600
13	C.V. Stem O-Ring	2	D256100	D256100	D256100	D257600
14	Retainer Nut	2	C175600	C175600	C175600	C176000
15	Retainer Washer	2	E219900	E219900	E220400	E220500
16	C.V. Seat Disc	2	D256000	D256000	D257200	D257500
17	Seat Disc Holder	2	F300005	F300005	F300105	F300205
18	1st Check Spring	1	A174000	A174000	A174300	A174500
19	2nd Check Spring	1	A174100	A-174100	A174400	A174600
20	Spring Retainer	2	E219805	E219805	E220205	E220305
21	Jam Nut	2	C158905	C158905	C158905	C170600
22	Cap O-Ring	2	D256600	D256600	D257400	D257700
23	C.V. Cap	2	Q453019	Q453019	Q453319	Q453719
24	Cap Bolt	12	B179700	B179700	B180100	B180000
25	Test Cock	3	7080301	7080301	7080301	7080401

\*2-1/2" & 3" QTY = 8 / 4" QTY = 16 / 6" QTY = 24

**8" - 10" RPZ (Model 40-200 Series)**  
 (shown without relief valve)

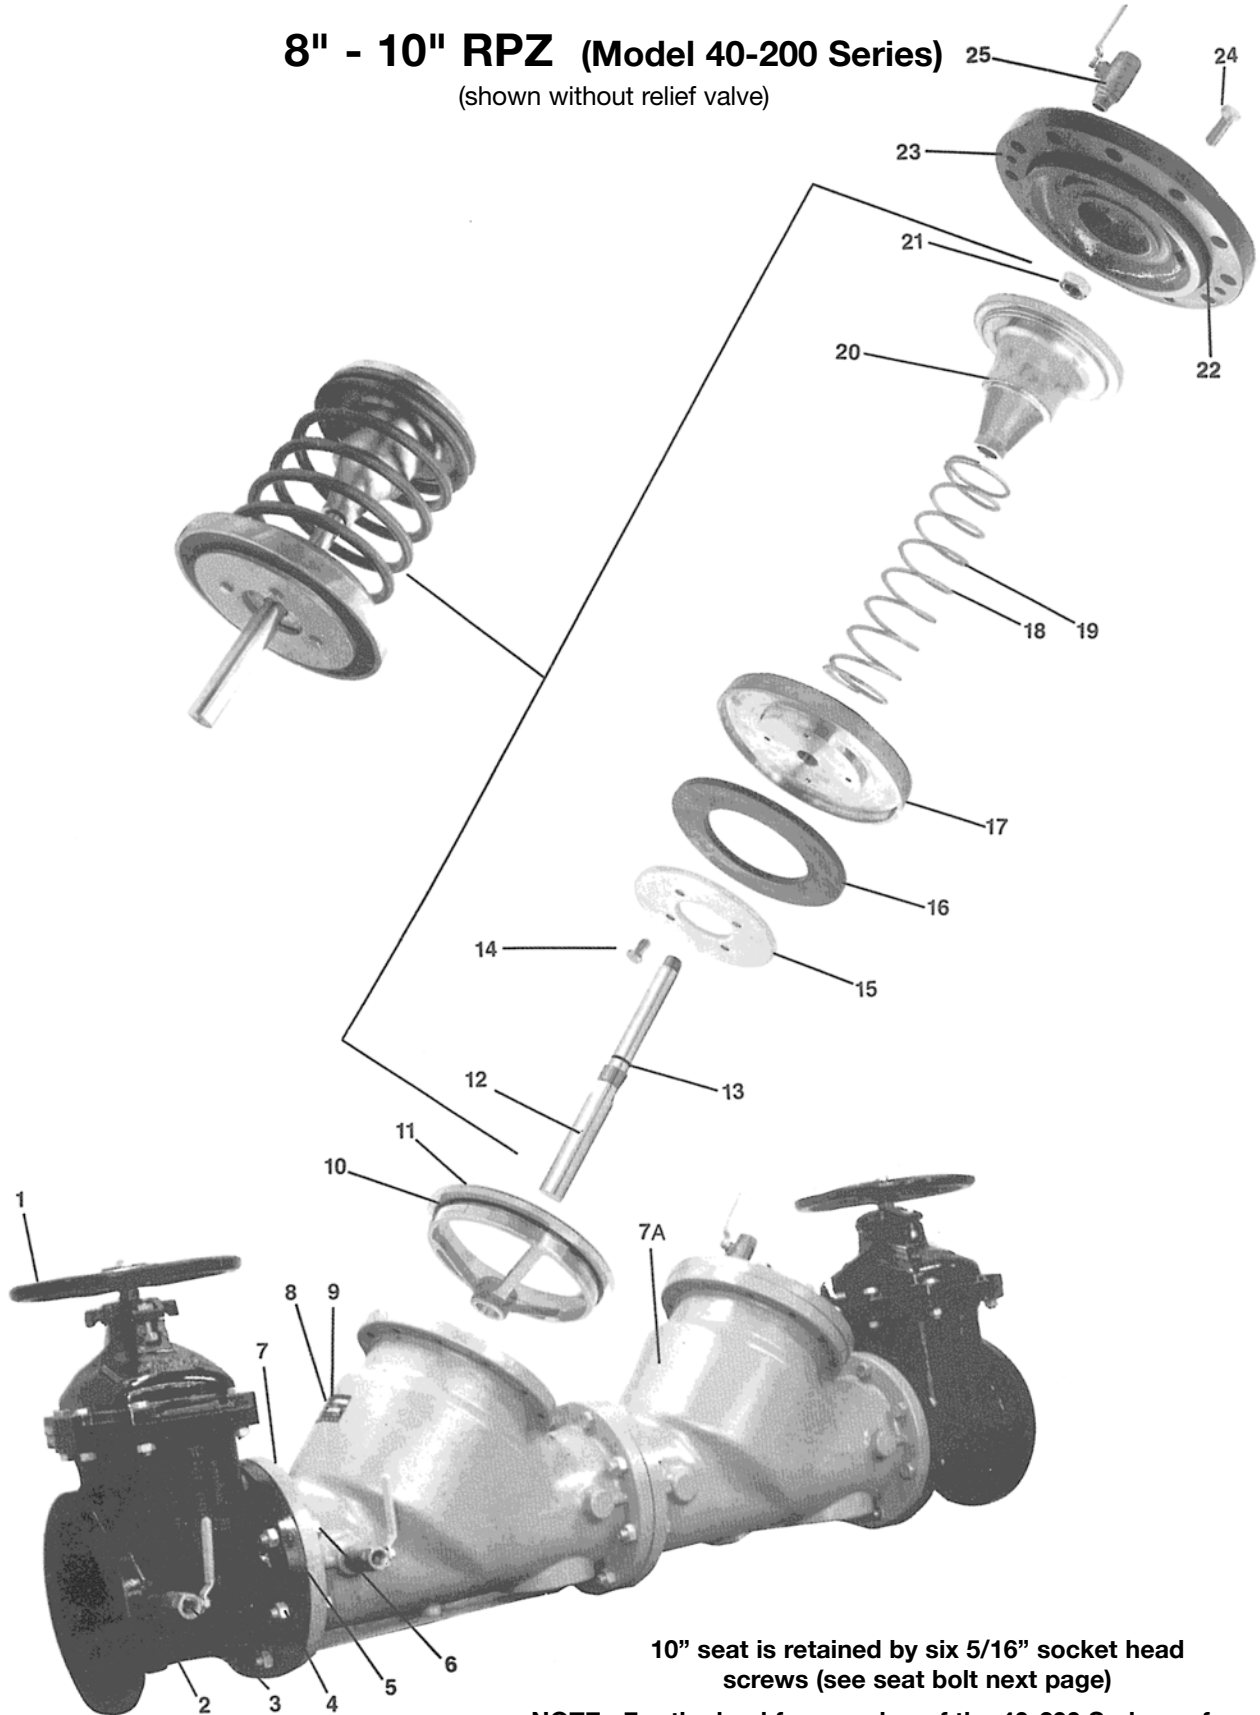

10" seat is retained by six 5/16" socket head screws (see seat bolt next page)

NOTE: For the lead free version of the 40-200 Series, refer to [www.apollovalves.com](http://www.apollovalves.com)


## RPZ (Model 40-200 Series)

### Parts List


ITEM NO.	DESCRIPTION	QUANTITY	PART NO.	
			8"	10"
1	Shut-Off Valve (OS&Y)	2	W682600	W685900
1	Shut-Off Valve (NRS)	2	W682700	W685800
2	Brass Nipple	1	K341200	K341200
3	Test Cock	1	7010401	7010401
4	Flange Nut	*	C175900	C179300
5	Ring Gasket	3	D259000	D265300
6	Flange Bolt	**	B185700	B185800
6A	Stud	2	N/A	B203600
7	Body	1	Q454319	Q457219
7A	Body	1	Q459319	Q459519
8	Nameplate	1	I440600	I440600
9	Drive Screw	2	I261300	I261300
10	C.V. Seat O-Ring	2	D258900	D258800
11	C.V. Seat	2	L465305	L475905
12	C.V. Stem	2	G327300	G330500
13	C.V. Stem O-Ring	2	D258700	D258700
14	Retainer Nut/Bolt	***	C175400	C175400
15	Retainer Washer	2	E220800	E222900
16	C.V. Seat Disc	2	D258600	D264900
17	Seat Disc Holder	2	F300805	F301905
18	1st Check Spring	1	A174700	A177800
19	2nd Check Spring	1	A174800	A177900
20	Spring Retainer	2	E220705	E222805
21	Jam Nut	2	*C176305	*C176305
22	Cap O-Ring	2	D258800	D265100
23	C.V. Cap	2	Q454519	Q457419
24	Cap Bolt	****	B169000	B188100
25	Test Cock	3	7080401	7080401
Not Shown	Seat Bolt (10" only)	12	N/A	B184900

8" QTY = 24 / 10" QTY = 38  
8" QTY = 24 / 10" QTY = 34  
8" & 10" QTY = 8  
8" & 10" QTY = 24

**2-1/2" - 6" Relief Valves**

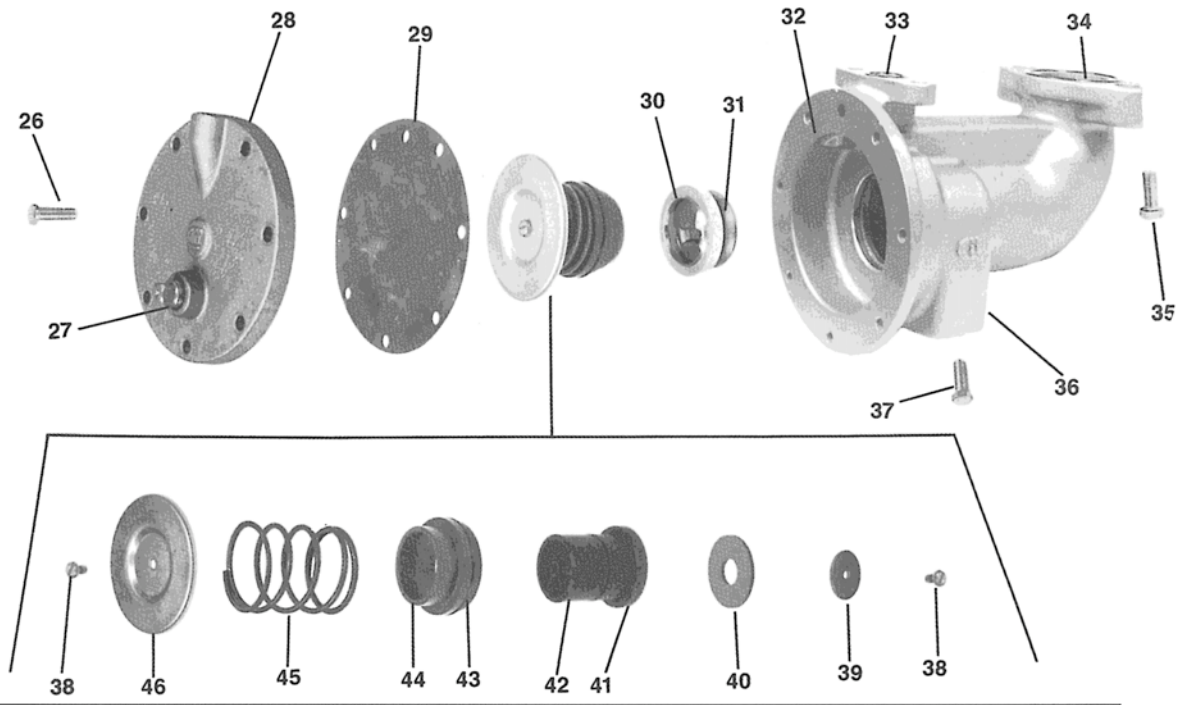

**8" & 10" Relief Valves**

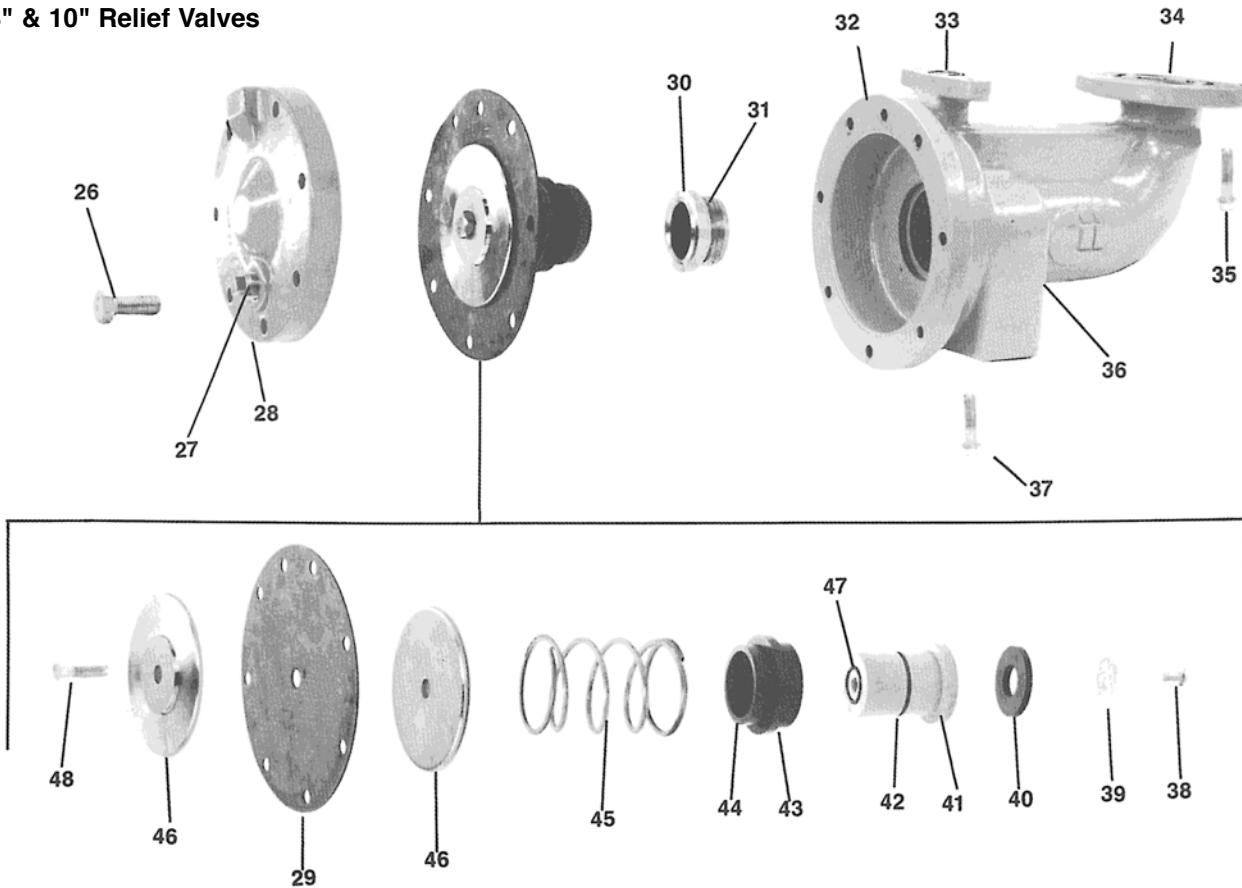

**NOTE: For the lead free version of the 40-200 Series, refer to [www.apollovalves.com](http://www.apollovalves.com)**

## RPZ (Model 40-200 Series)

### Parts List

ITEM NO.	DESCRIPTION	QUANTITY	PART NO.	
			2-1/2" - 6"	8", 10"
26	Relief Valve Cover Bolt	7	B179600	7 B170300
27	1/2 NPT Plug	1	K300800	N/A N/A
27	3/4 NPT Plug	N/A	N/A	1 K301000
28	Relief Valve Cover	1	Q453105	1 Q454219
29	Relief Valve Diaphragm	1	D256400	1 D259100
30	Relief Valve Seat Ring	1	L463805	1 L465105
31	Relief Valve Seat Ring O-Ring	1	D256800	1 D2593-00
32	Relief Valve Body	1	Q453505	1 Q454119
33	Small Relief Valve O-Ring	1	D257000	1 D218600
34	Large Relief Valve O-Ring	1	D257100	1 D230400
35	Relief Valve Flange Bolt	2	B180000	4 B166900
36	1/4 NPT Plug	1	K301900	1 K301900
37	Relief Valve Flange Bolt	2	B179200	2 B166900
38	Pan Head Screw	2	B175300	1 B185600
39	Relief Valve Seat Washer	1	E220000	1 E221000
40	Relief Valve Seat Disc	1	D256300	1 D259500
41	Relief Valve Stem	1	G324000	1 G327405
42	Relief Valve Stem O-Ring	1	D256200	1 D259400
43	Relief Valve Bushing O-Ring	1	D256200	1 D259200
44	Relief Valve Bushing	1	L463915	1 L465215
45	Relief Valve Spring	1	A174200	1 A174900
46	Diaphragm Plate	1	E220100	2 E220905
47	Stem Face O-Ring	N/A	N/A	1 D210600
48	Diaphragm Bolt	N/A	N/A	1 B180000

Repair Kits



	PART NO.				
	2-1/2", 3"	4"	6"	8"	10"
<u>1st Check Valve Repair Kit</u> 12, 13, 14, 15, 16, 17, 18, 20, 21, 22	4000901	4000A01	4000C01	4000E01	4000G01
<u>2nd Check Valve Repair Kit</u> 12, 13, 14, 15, 16, 17, 19, 20, 21, 22	4000902	4000A02	4000C02	4000E02	4000G02
<u>Seat Repair Kit</u> 10, 11, 22	4000903	4000A03	4000C03	4000E03	4000G03
<u>Check Rubber Repair Kit (2 of ea. part)</u> 10, 13, 16, 22	4000904	4000A04	4000C04	4000E04	4000G04
<u>Relief Valve Repair Kit</u> 29, 30, 31, 33, 34, 38, 39, 40, 41, 42, 43, 44, 45, 46, (47, 48)*	4000905	4000A05	4000C05	4000E05	4000G05
<u>Relief Valve Rubber Repair Kit</u> 29, 31, 33, 34, 40, 42, 43, (47)*	4000906	4000A06	4000C06	4000E06	4000G06

\*8" &amp; 10" Only

**NOTES:**

1. USE P/N W-7062-00 FOR METER IN CUBIC FEET REGISTER.  
USE P/N W-7094-00 FOR METER IN GALLONS REGISTER.
2. N/S - NOT SHOWN

**3" - 4"**

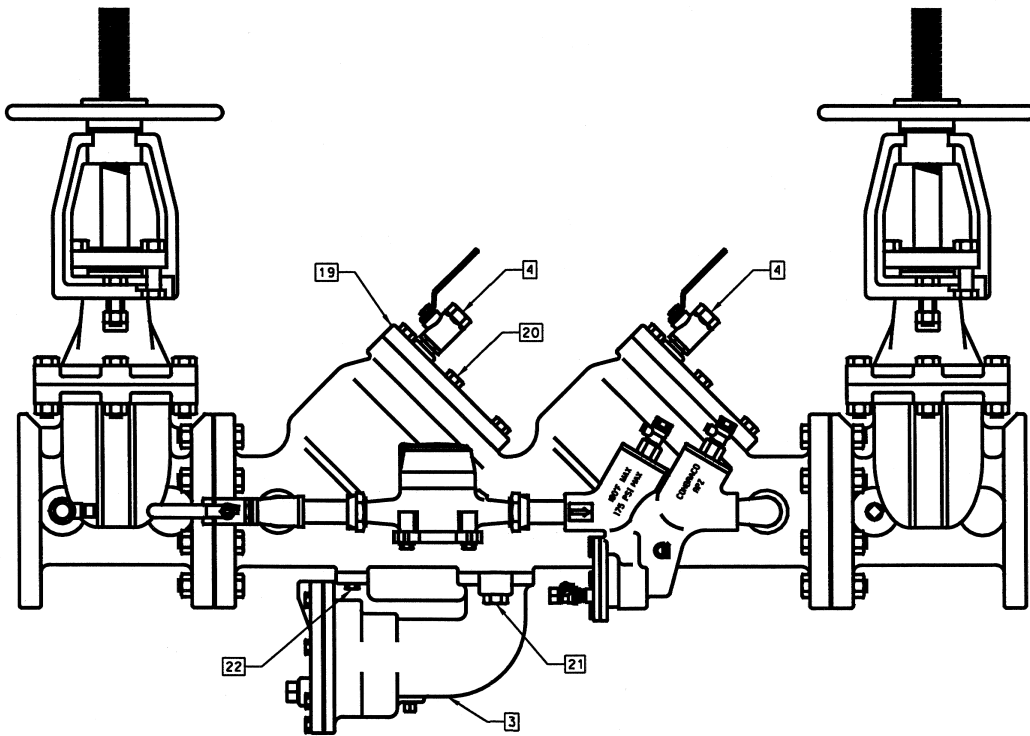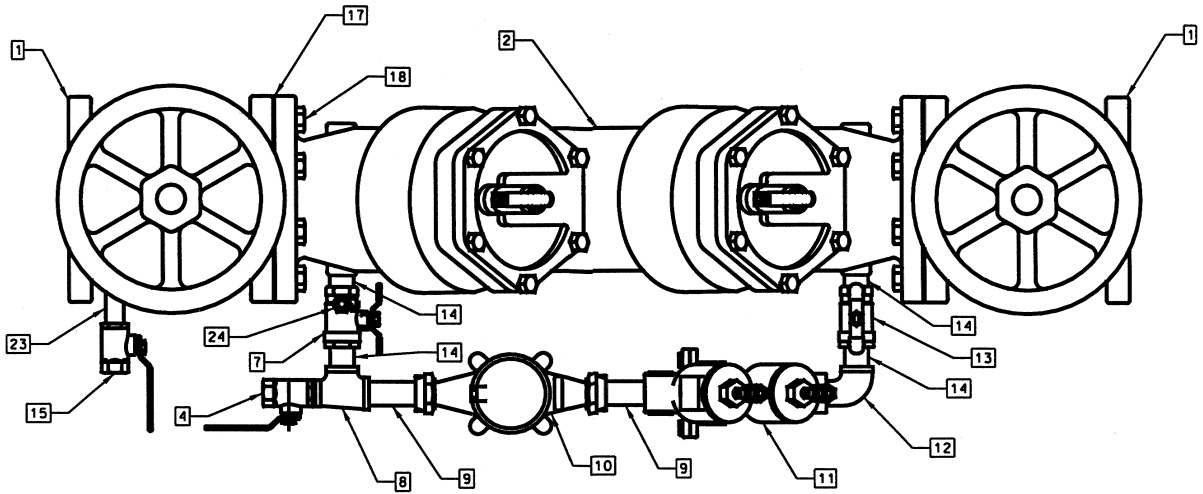

**RPDA By-Pass Assembly Kits:**

3" RPDA w/meter in cubic feet	40700BPC
3" RPDA w/meter in gallons	40700BPE
4" RPDA w/meter in cubic feet	4070ABPC
4"RPDA w/meter in gallons	4070ABPE

## RPDA (Model 40-700 Series)

### Parts List

ITEM NO.	DESCRIPTION	QUANTITY	PART NO.	
			3"	4"
1	Gate Valve (OS&Y)	2	W679000	W682400
2	RPDA Body	1	Q493419	Q480719
3	Relief Valve Ass'y	1	W672905	W672905
4	Test Cock	3	7080301	7080301
N/S	1st Chk Poppet Ass'y	1	W671705	W673005
N/S	2nd Chk Poppet Ass'y	1	W728905	W710005
7	By-Pass Shut-Off Valve	1	7B10401	7B10401
8	Tee, Reducing	1	K350600	K350600
9	Coupling, Water Meter	2	K350500	K350500
10	Water Meter in Cubic Feet	1	W706200	W706200
10	Water Meter in Gallons	1	W709400	W709400
11	3/4" RPZ	1	W739005	W739005
12	Elbow, Street	*	K350200	K350200
13	By-Pass Shut-Off Valve	1	7B10431	7B10431
14	Nipple, Close	4	K337000	K337000
15	Test Cock	1	7010301	7010301
N/S	Flange Nut	**	C143800	C143800
17	Flange Gasket	2	D258400	D258200
18	Flange Bolt	**	B180400	B182800
19	Cap	2	Q453019	Q453319
20	Cap Bolt	12	B179700	B180100
21	Relief Valve Flange Bolt (Lg.)	2	B180000	B180000
22	Relief Valve Flange Bolt (Sm.)	2	B179200	B179200
23	Nipple	1	K340600	K340600
24	Test Cock	1	7825701	7825701
N/S	Nipple, 3/4" x 4-1/2" (Lg.)	1	K360500	N/A
N/S	Elbow, 3/4" - 90°	1	K350100	N/A
N/S	Cap O-Ring	2	D256600	D257400
N/S	Seat O-Ring	2	D256700	D257300
N/S	Relief Valve O-Ring (Sm.)	1	D257000	D257000
N/S	Relief Valve O-Ring (Lg.)	1	D257100	D257100
N/S	Nameplate	1	I499100	I499100
N/S	Nameplate Tack	2	I529400	I529400
N/S	Instruction Booklet	1	I503600	I503600
N/S	Check Valve Seat	2	L463705	L464005


\* 3" QTY = 3 / 4" QTY = 1

\*\* 3" QTY = 8 / 4" QTY = 16

**NOTES:**

- 1. USE P/N W-7062-00 FOR METER IN CUBIC FEET REGISTER.  
USE P/N W-7094-00 FOR METER IN GALLONS REGISTER.
- 2. N/S - NOT SHOWN

**6" - 10"**

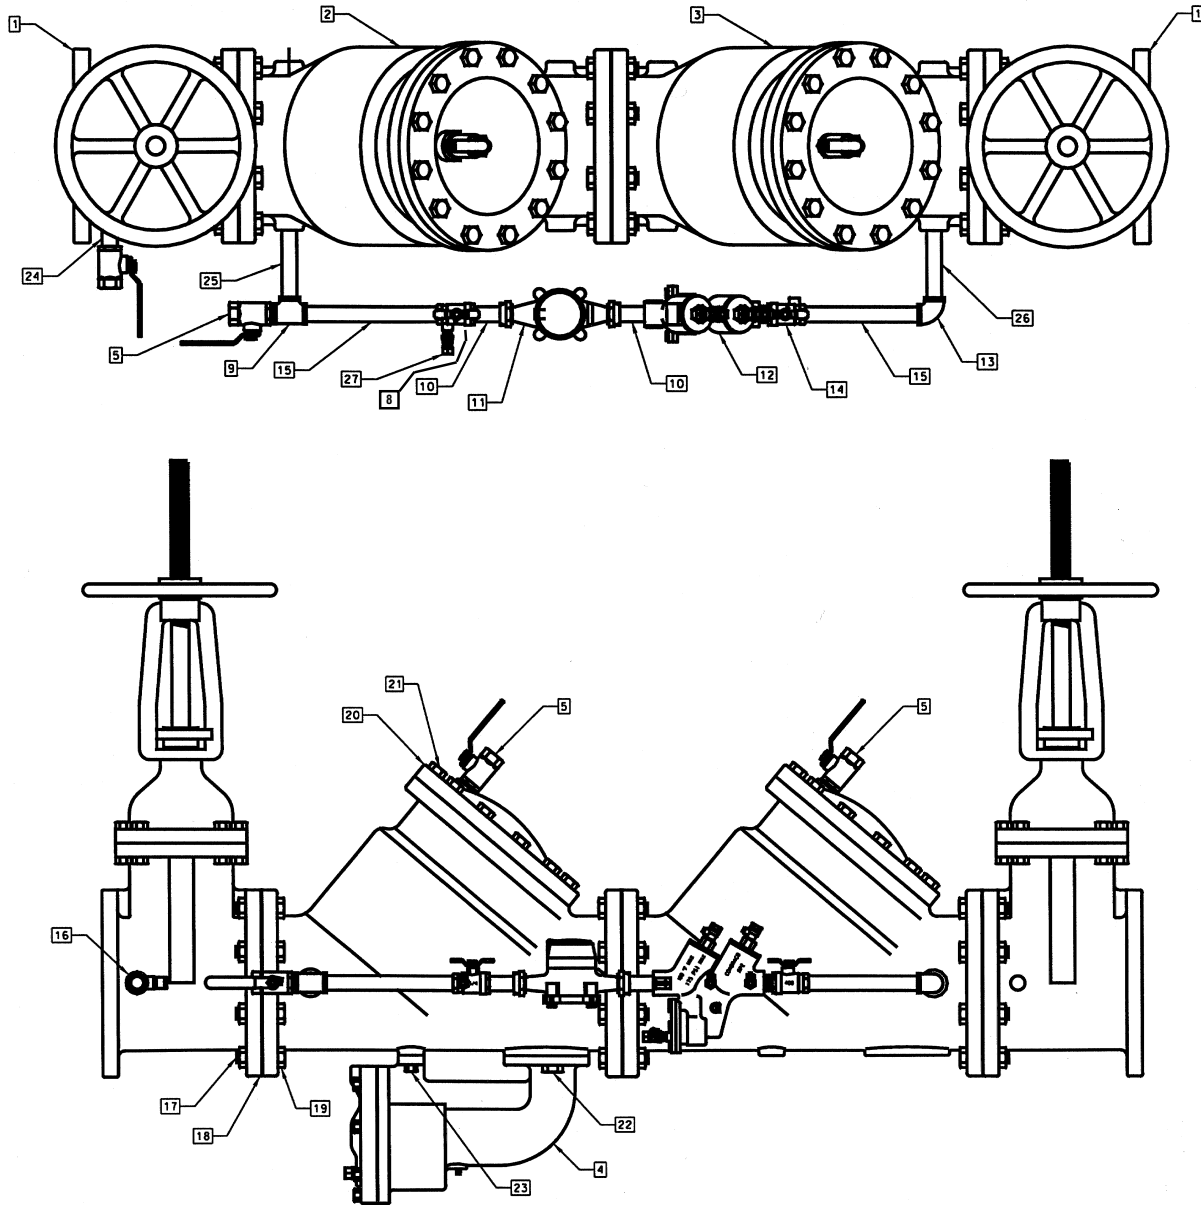

**RPDA By-Pass Assembly Kits:**

- |                                |          |
|--------------------------------|----------|
| 6" RPDA w/meter in cubic feet  | 4070CBPC |
| 6" RPDA w/meter in gallons     | 4070CBPE |
| 8" RPDA w/meter in cubic feet  | 4070EBPC |
| 8"RPDA w/meter in gallons      | 4070EBPE |
| 10" RPDA w/meter in cubic feet | 4070GBPC |
| 10"RPDA w/meter in gallons     | 4070GBPE |



# RPDA

## Parts List

ITEM NO.	DESCRIPTION	QUANTITY	PART NO.		
			6"	8"	10"
1	Gate Valve (OS&Y)	2	W682500	W682600	W685900
2	Body (1st Check)	1	Q453819	Q454319	Q457219
3	Body (2nd Check)	1	Q459119	Q459319	Q459519
4	Relief Valve Ass'y	1	W672905	W674805	W674805
5	Test Cock	3	7080401	7080401	7080401
N/S	1st Chk Poppet Ass'y	1	W674105	W674505	W685605
N/S	2nd Chk Poppet Ass'y	1	W720605	W720705	W724905
8	By-Pass Shut-Off Valve	1	7B10401	7B10401	7B10401
9	Tee, 3/4" NPT	1	K351100	K351100	K351100
10	Coupling, Water Meter	2	K350500	K350500	K350500
11	Water Meter in Cubic Feet	1	W706200	W706200	W706200
11	Water Meter in Gallons	1	W709400	W709400	W709400
12	3/4" RPZ	1	W739005	W739005	W739005
13	Elbow, 3/4" NPT	1	K350100	K350100	K350100
14	By-Pass Shut-Off Valve	1	7B80431	7B80431	7B80431
15	Nipple, 3/4" NPT	2	K350900	K352700	K356000
16	Test Cock	1	7010401	7010401	7010401
17	Flange Nut	*	C175900	C175900	C179300
18	Flange Gasket	3	D257900	D259000	D265300
19	Flange Bolt	**	B182900	B185700	B185800
20	Cap	2	Q453719	Q454519	Q457419
21	Cap Bolt	***	B180000	B169000	B188100
22	Relief Valve Flange Bolt (Lg.)	****	B180000	B166900	B166900
23	Relief Valve Flange Bolt (Sm.)	2	B179200	B166900	B166900
24	Nipple, 3/4" NPT	1	K341200	K341200	K341200
25	Nipple, 3/4" x 5-1/2" (Lg.)	1	K350900	K350900	K350900
26	Nipple, 3/4" NPT	1	K350900	K350900	K355900
27	Test Cock	1	7825701	7825701	7825701
N/S	Elbow, 3/4" - 90°	1	K350100	K350100	K350100
N/S	Cap O-Ring	2	D257700	D258800	D265100
N/S	Seat O-Ring	2	D257600	D258900	D258800
N/S	Relief Valve O-Ring (Sm.)	1	D257000	D218600	D218600
N/S	Relief Valve O-Ring (Lg.)	1	D257100	D230400	D230400
N/S	Nameplate	1	I499100	I499100	I499100
N/S	Nameplate Tack	2	I529400	I529400	I529400
N/S	Instruction Booklet	1	I503600	I503600	I503600
N/S	Check Valve Seat	2	L464405	L465305	L475905
N/S	Stud	2	N/A	N/A	B203600
N/S	Seat Bolt	12	N/A	N/A	B184900

\* 6" & 8" QTY = 24 / 10" QTY = 38

\*\* 6" & 8" QTY = 24 / 10" QTY = 34

\*\*\* 6" QTY = 12 / 8" & 10" QTY = 24

\*\*\*\* 6" QTY = 2 / 8" & 10" QTY = 4

---

---

# BACKFLOW PREVENTER TEST KITS

## DESCRIPTION

The Conbraco Backflow Preventer Test Kits are compact, lightweight and portable testing devices. They come equipped with a gauge, hoses and all required adapter fittings. Also included is a flexible or adjustable strap for hanging the gauge, laminated test procedures and a molded plastic carrying case with foam inserts.

### DIFFERENTIAL PRESSURE GAUGE TEST KIT 40-200-TKU

This is a three valve test kit used for testing all DCV, RPZ, PVB & SVB backflow preventers.

The gauge is a differential pressure type with a dual scale of 0-15 psid/0-100kPa differential pressure range with a  $\pm 2\%$  accuracy (full scale).

### 40-200-TK5U

This five valve kit is used for testing all DCV, RPZ, PVB & SVB backflow preventers.

The five valve test kit is similar to the three valve kit except it has an additional two valves that make it possible to bleed lines without disconnecting hoses.



MODEL	APPLICATION	WT./Ea.(lbs)
40-200-TKU	ALL DCV, RPZ, PVB & SVB	7.80
40-200-TK5U	ALL DCV, RPZ, PVB & SVB	6.50





# 'Apollo' Valves

Manufactured by Conbraco Industries, Inc.

Sales and Service Department  
Phone: 704-841-6000 • Fax: 704-841-6020

			E-Mail Address	Phone	Fax	
Southeast Region	<b>Spirit Group</b>	Florida (except Pan Handle)	info@spiritgroupinc.com	407-291-6035	407-299-0378	
	<b>Spotswood Associates</b>	Georgia/Alabama	dlewis@spotswoodassociates.com	770-447-1227	770-263-6899	
	<b>Pro Marketing, Inc.</b>	North Carolina/South Carolina/Tennessee-East	sales@promarketinginc.net	864-578-4334	864-578-4889	
	<b>Mid South Marketing, Inc.</b>	Virginia/Maryland/Washington, D.C./WV-East	midsouth7@aol.com	804-213-3801	804-213-3802	
Southern Region	<b>Southern Marketing Group</b>	MS/TN-West/AR/Bowie Cty.-TX	SMG49@bellsouth.net	901-547-0042	901-547-0035	
	<b>AVC Mechanical Sales, Inc.</b>	Oklahoma (Plmb & Ind'l)/Texas-North (All)	valvesales@avalve.com	214-201-0100	214-201-0104	
	<b>Armstrong/Weatherly Associates</b>	Texas-South/Louisiana	sales@armstrong-weatherly.com	713-692-5566	713-692-6021	
	<b>Lightsey Marketing</b>	Oklahoma (Irrigation, Fire Protection, Water Works)	karenandmarilyn@yahoo.com	918-251-2828	918-251-7742	
Midwestern Region	<b>New Tech Marketing</b>	IL/WI-East/IN-North/MI-Upper Peninsula/IA-/River Counties	ntm012@mcleodusa.net	630-378-4300	630-378-0343	
	<b>New Tech Marketing</b>	Eastern Missouri/Southern Illinois/Kansas City	ntm112@aol.com	618-394-0329	618-394-0427	
	<b>Whitfill-McCarthy, LLC</b>	Kentucky/Indiana-South/Ohio-South	whitfill@win.net	502-459-4545	502-459-9944	
	<b>V.E. Sales Co., Inc.</b>	Michigan (Except Upper Peninsula)	tomv@vesalesinc.com	586-774-7760	586-774-1490	
	<b>Formation Sales</b>	Minnesota/North & South Dakota/Wisconsin-West	dean@formationsales.com	763-262-4700	763-262-4740	
	<b>Marshall-Rodeno Heartland</b>	Nebraska/Iowa (Except River Counties)	trodono@marshallrodeno.com	303-575-6701	303-575-6706	
	<b>Midwest Spec</b>	Ohio-North/Pennsylvania-West/West Virginia-West	glsales@mwspec.com	330-538-0406	330-538-0410	
<b>Warren Thoma Associates</b>	MI/WI/IL/IN/KY/OH (Irrigation Only)	penny@thomaassociates.com	815-477-1814	815-477-2009		
Western Region	<b>Spec Management Group</b>	California-South (Irrigation), Hawaii (All Products)	msmarch4@cox.net	949-481-4225	949-487-0990	
	<b>Specified Process Equipment Co.</b>	California - North	jd@specifiedprocess.com	707-747-3466	707-747-4957	
	<b>Marshall-Rodeno Associated</b>	CO/WY/MT/ID-SE/UT/NV-NE/NM/EI Paso-TX	trodono@marshallrodeno.com	303-575-6701	303-575-6706	
	<b>Suntoya Corporation</b>	WA, OR, AK, Northern counties ID	kim@suntoya.com	509-534-1516	509-535-6546	
	<b>Southwestern Industrial Sales Co.</b>	Arizona/Nevada-SW	eduardop@sw-ind.com	480-458-5838	480-458-5843	
	<b>Jack Prust Sales</b>	California-North (Irrigation)	jack@jpsales.com	530-878-2922	530-878-2341	
<b>Active Sales Northwest, Inc</b>	Oregon, WA, Western Idaho (Irrigation)	skactive@aol.com	541-726-0320	541-726-1148		
Northeast Region	<b>Urell, Inc.</b>	Massachusetts/New England States	conbraco@urell.com	617-923-9500	617-926-9414	
	<b>McMahon Marketing, Inc.</b>	New York-Upstate/New York-West	sales@mcmahonmarketing.com	518-792-3350	518-792-3351	
	<b>Conroy &amp; Griese Sales, Inc.</b>	New York-East/New Jersey-North	iezzi52@aol.com	856-663-4440	856-663-6644	
	<b>Layden Company</b>	Pennsylvania-East/Delaware/New Jersey-South	joejr@laydencompany.com	610-363-6657	877-529-3361	
	<b>Keith Engle &amp; Associates</b>	OEM accounts	keith.engle@verizon.net	610-827-9560	610-827-9561	
	<b>Waterlines, Inc.</b>	New England/Upstate, Metro NY/PA/VA (Irrigation Only)	waterlines@nac.net	973-209-7777	973-209-7421	
Canada	<b>Conbraco Industries, Canada</b>	178 Pennsylvania Ave., Unit 1, Concord, Ontario L4K 4B1	conbraco.canada@conbraco.com	905-761-6161	905-761-6666	
	<b>Barclay Sales Ltd.</b>	British Columbia	bbarclay@barclaysales.com	604-945-1010	604-945-3030	
	<b>D &amp; M Mechanical Sales</b>	Ontario/East	dou@dandmsales.ca	613-384-7084	613-384-3407	
	<b>Dynamic Agencies, Ltd.</b>	Saskatchewan	don.dynamicage@sasktel.net	306-343-1901	306-343-1901	
	<b>Tom Beggs Agencies Ltd.</b>	Manitoba/NW Ontario	TBA@MB.SYMPATICO.CA	204-953-1900	204-774-6915	
	<b>Task Controls, Inc.</b>	Ontario	infotoronto@taskcontrols.com	416-291-3004	416-754-3481	
	<b>Agences J. Pierre Sylvain, Inc.</b>	Quebec	agencespsylvain@golden.net	450-655-9588	450-641-2737	
	<b>Kern Industries, Ltd.</b>	Alberta-North	kernind@telusplanet.net	780-451-2056	780-454-6687	
	<b>Kern Industries Calgary, Ltd.</b>	Alberta-South	marty.yucytus@kernindustries.ca	403-730-7791	403-239-8179	
	<b>J. Levandier Sales, Inc.</b>	Nova Scotia, New Brunswick, Prince Edward Island and Newfoundland	jlssales@istar.ca	506-858-1615	506-858-1084	
	<b>Key to the North Sales Agency, Inc.</b>	Ontario-North	hmehes@keytothenorth.ca	705-524-6714	705-566-0148	
Int'l.	<b>Sadek Trading</b>	Middle East (except Israel)	ysadek@aol.com	704-618-6613	980-233-8437	
	<b>Conbraco International Sales:</b>	Mexico	jose.arias@conbraco.com	956-631-4542	956-631-4681	
		Caribbean	luis.guzman@conbraco.com	787-739-5620		
		Central & South America	esteban.bejarano@conbraco.com	506-8836-0759		
		Asia Pacific	jonathan.yap@conbraco.com	65-9626-9241	65-6753-0131	
		Europe	allen.bellamy@conbraco.com	44-161-212-3745	44-161-212-3747	
		Africa/Australia/Israel/India	donna.bult@conbraco.com	954-252-9781	954-252-8698	
	<b>Regional Sales Managers:</b>					
		Brian Blalock (East)		brian.blalock@conbraco.com	704-624-3744	704-841-6021
		Steve Brown (Northwest)		steve.brown@conbraco.com	425-985-5095	253-862-3548
	John Wilson (West)		john.wilson@conbraco.com	760-330-3293	775-854-5722	

Conway, SC • Matthews, NC • Pageland, SC • Customer Service 1-704-841-6000 • www.apollovalves.com