



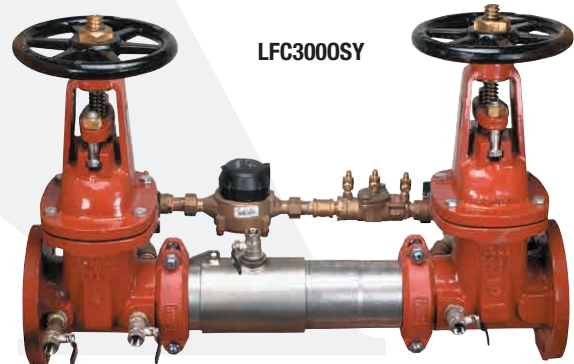

# Colt™ Series LFC300, LFC300N

Double Check Detector Assemblies  
 Sizes: 2 1/2" – 10" (65-250mm)\*\*

**LEAD FREE\***

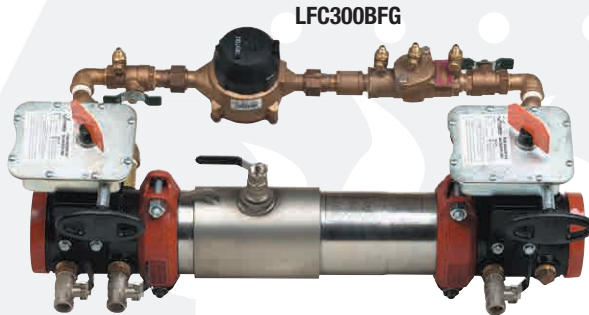

## Features

- Extremely Compact Design
- 70% Lighter than Traditional Designs
- 304 (Schedule 40) Stainless Steel Housing & Sleeve
- Groove Fittings Allow Integral Pipeline Adjustment
- Patented Tri-Link Check Provides Lowest Pressure Loss
- Unmatched Ease of Serviceability
- Available with Grooved Butterfly Valve Shutoffs
- May be Used for Horizontal, Vertical or N Pattern Installations
- Replaceable Check Disc Rubber

The Colt LFC300, LFC300N Double Check Detector Assemblies are used to prevent backflow of pollutants, that are objectionable but not toxic, from entering the potable water supply system. The Colt LFC300, LFC300N may be installed under continuous pressure service and may be subjected to backpressure. The Colt LFC300, LFC300N is used primarily on fire line sprinkler systems when it is necessary to monitor unauthorized use of water. For use in non-health hazard applications.

## Specifications

The Colt LFC300, LFC300N Double Check Detector Assemblies shall consist of two independent Tri-Link Check modules within a single housing, sleeve access port, four test cocks and two drip tight shutoff valves. Tri-Link Checks shall be removable and serviceable, without the use of special tools. The housing shall be constructed of 304 (Schedule 40) stainless steel pipe with groove end connections. Tri-Link Checks shall have reversible elastomer discs and in operation shall produce drip tight closure against the reverse flow of liquid caused by backpressure or backsiphonage. The bypass assembly shall consist of a meter, which registers in either gallon or cubic measurement, a double check valve assembly and required test cocks. Assembly shall be a Colt LFC300, LFC300N as manufactured by the Ames Company.

\*\* Metric Dimensions are nominal pipe diameter. This product is produced with ASME/ANSI flanged end connections.

**NOTICE**

The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.

\*The wetted surface of this product contacted by consumable water contains less than 0.25% of lead by weight.

Job Name \_\_\_\_\_ Contractor \_\_\_\_\_

Job Location \_\_\_\_\_ Approval \_\_\_\_\_

Engineer \_\_\_\_\_ Contractor's P.O. No. \_\_\_\_\_

Approval \_\_\_\_\_ Representative \_\_\_\_\_

## Configurations

- Horizontal
- Vertical up
- “N” pattern horizontal

## Materials

- Housing & Sleeve: 304 (Schedule 40) Stainless Steel
- Elastomers: EPDM, Silicone and Buna ‘N’
- Tri-Link Checks: Noryl®, Stainless Steel
- Check Discs: Reversible Silicone or EPDM
- Test Cocks: Lead Free\* Copper Silicon Alloy Body Nickel Plated
- Pins & Fasteners: 300 Series Stainless Steel
- Springs: Stainless Steel

## Available Models

Suffix:

OSY - UL/FM outside stem and yoke resilient seated gate valves

BFG - UL/FM grooved gear operated butterfly valves with tamper switch

\*OSY FxG - Flanged inlet gate connection and grooved outlet gate connection

\*OSY GxG - Grooved inlet gate connection and flanged outlet gate connection

\*OSY GxG - Grooved inlet gate connection and grooved outlet gate connection

Available with grooved NRS gate valves - consult factory\*

Post indicator plate and operating nut available - consult factory\*




\*Consult factory for dimensions

## Dimensions — Weights

## Pressure — Temperature




Temperature Range: 33°F – 110°F (5°C – 43°C)

Maximum Working Pressure: 175psi (12.06 bar)

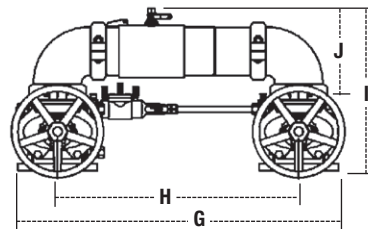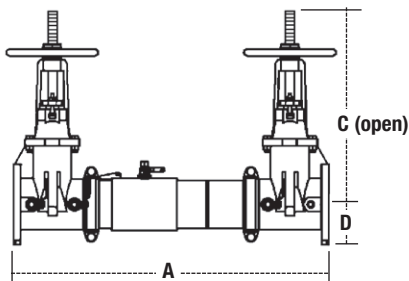

### LFC300, LFC300N

SIZE		DIMENSIONS														WEIGHT					
in.	mm	A		C (OSY)		D		G		H		I		J		P		LFC300		LFC300N	
		in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kgs.	lbs.	kgs.
2½	65	30¾	781	16¾	416	3½	89	29½	738	21½	546	15½	393	8¼	223	13¾	335	139	63	147	67
3	80	31¾	806	18¾	479	3½	94	30¼	768	22¼	565	17¾	435	9¾	233	14½	368	159	72	172	78
4	100	33¾	857	22¾	578	4	102	33	838	23½	597	18½	470	9½	252	15¾	386	175	79	198	90
6	150	43½	1105	30¾	765	5½	140	44¾	1137	33¼	845	23¾	589	13¼	332	19	483	309	140	350	159
8	200	49¾	1264	37¾	959	6½	170	54¾	1375	40¾	1019	27¾	697	15¼	399	21¾	538	494	224	569	258
10	250	57¾	1467	45¾	1162	8¾	208	66	1676	49½	1257	32½	826	17¾	440	24	610	795	361	965	438

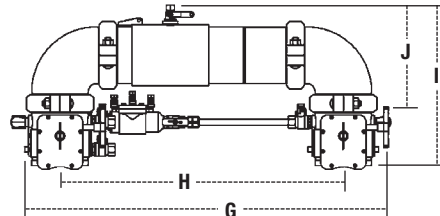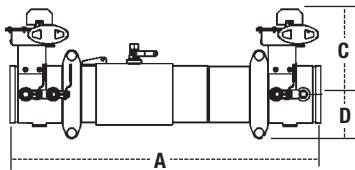

### LFC300BFG, LFC300NBFG

SIZE		DIMENSIONS														WEIGHT					
in.	mm	A		C		D		G		H		I		J		P		LFC300BFG		LFC300NBFG	
		in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kgs.	lbs.	kgs.
2½	65	27¾	705	8	203	3½	89	29½	759	21½	546	14½	379	8¼	223	13	330	70	32	78	35
3	80	28¼	718	8½	211	3½	94	30¼	779	22¼	565	15¾	392	9¾	233	13½	343	68	31	81	37
4	100	29	737	8½	227	3½	94	31½	811	23½	597	16¼	412	9½	252	14	356	75	34	98	44
6	150	36½	927	10	254	5	127	43¾	1097	33¼	845	19¼	500	13¼	332	14½	368	131	59	171	78
8	200	42¾	1086	12¼	311	6½	165	51¼	1297	40¾	1019	23¾	592	15¼	399	18¾	462	275	125	351	159

Noryl® is a registered trademark of SABIC Innovative Plastics™.

\*\* Metric Dimensions are nominal pipe diameter. This product is produced with ASME/ANSI flanged end connections.

# Approvals

- Approved by the Foundation for Cross-Connection Control and Hydraulic Research at The University of Southern California (FCCCHR-USC)

For additional approval information please contact the factory or visit our website at [www.amesfirewater.com](http://www.amesfirewater.com)









# Capacity

UL/FM Certified Flow Characteristics  
Flow characteristics collected using butterfly shutoff valves.

## Flow capacity chart identifies valve performance based upon rated water velocity up to 25fps

- Service Flow is typically determined by a rated velocity of 7.5fps based upon schedule 40 pipe.
- Rated Flow identifies maximum continuous duty performance determined by AWWA.
- UL Flow Rate is 150% of Rated Flow and is not recommended for continuous duty.
- AWWA Manual M22 [Appendix C] recommends that the maximum water velocity in services be not more than 10fps.

\_\_\_\_\_ Horizontal    \_\_\_\_\_ Vertical    ..... N - Pattern

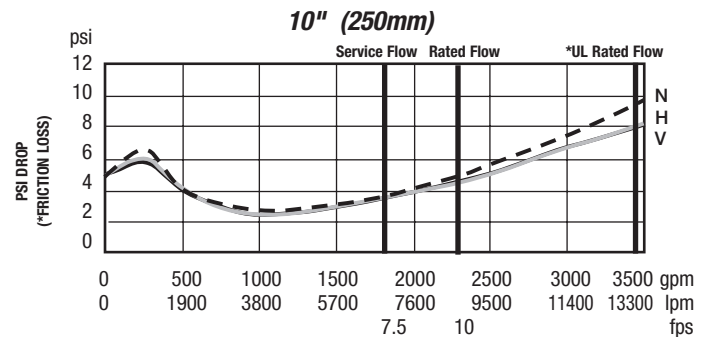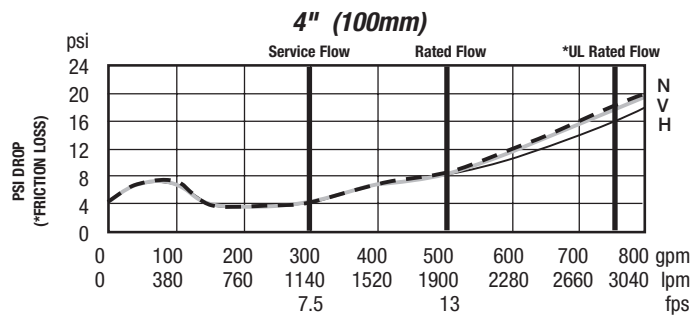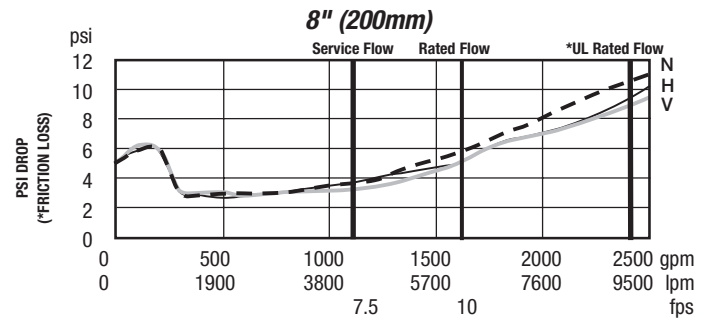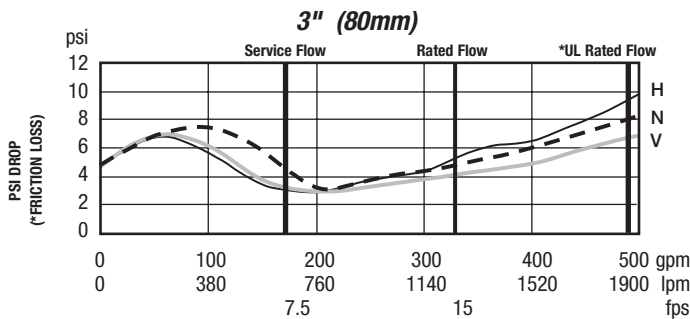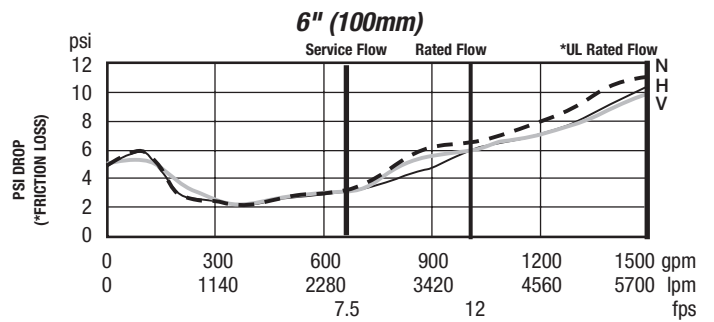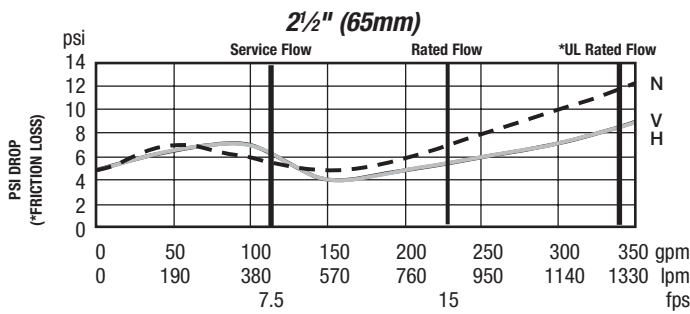

## NOTICE

Inquire with governing authorities for local installation requirements



*A Watts Water Technologies Company*

---

**USA: Backflow** Tel: (978) 689-6066 • Fax: (978) 975-8350 • [AmesFireWater.com](http://AmesFireWater.com)  
**USA: Control Valves** Tel: (713) 943-0688 • Fax: (713) 944-9445 • [AmesFireWater.com](http://AmesFireWater.com)  
**Canada:** Tel: (905) 332-4090 • Fax: (905) 332-7068 • [AmesFireWater.ca](http://AmesFireWater.ca)  
**Latin America:** Tel: (52) 81-1001-8600 • Fax: (52) 81-8000-7091 • [AmesFireWater.com](http://AmesFireWater.com)